

①

Uhaul Moving

Storage

8816 SE Foster Rd

Scope: Install a New 60amp Service Panel to replace an Existing 120volt Service Panel. A new propane pump has been installed replacing an existing 120v pump. The new propane pump requires 240v. The old Service panel will act as a junction Box

Applicant: McMullen Electric

P.O. Box 433

Amity, OR 97101


503-435-9487

mcullenelectric@yahoo.com

Approved Except as Noted
Subject to the minimum
Requirements of the N.E.C.,
State of Oregon Electrical
Regulations and Title 26
of the City of Portland

13-119781-81

Uhaul Moving & Storage
8816 SE Foster Rd

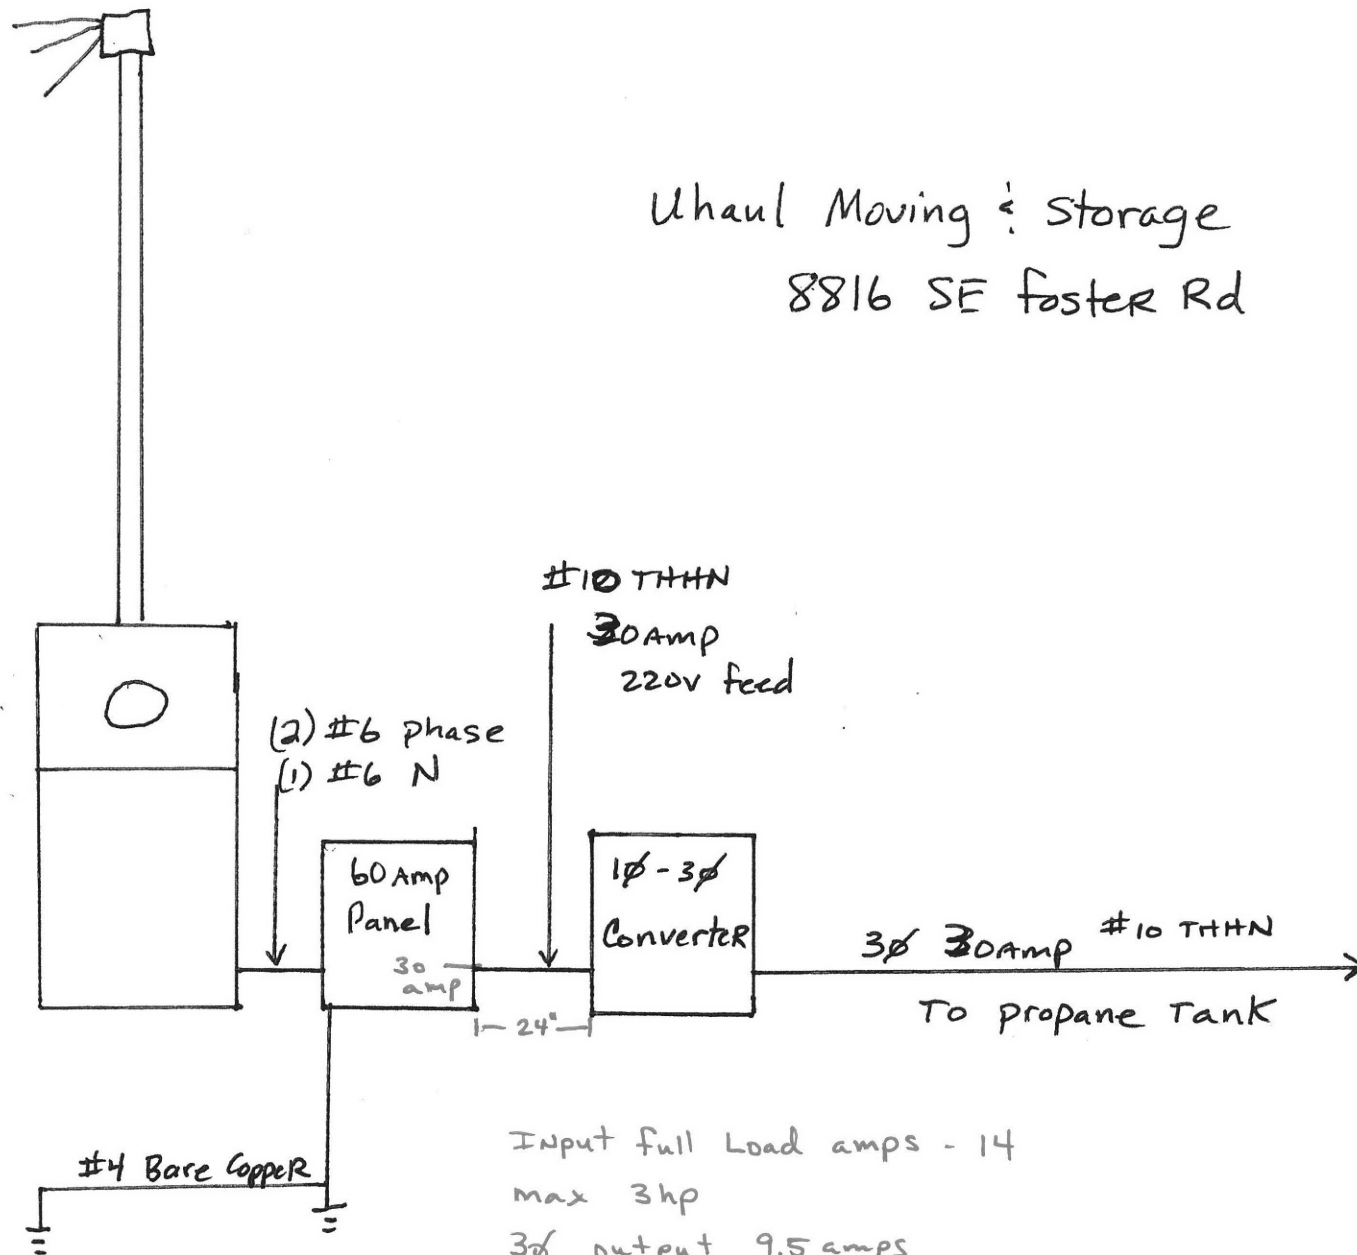

Input full Load amps - 14
max 3hp
3 ϕ output 9.5 amps
230 input / 230 output
UL listed / Nema 3R

Approved Except as Noted
Subject to the minimum
requirements of the N.E.C.,
State of Oregon Electrical
Regulations and Title 26
of the City of Portland

