



CITY OF
PORTLAND, OREGON
BUREAU OF DEVELOPMENT SERVICES
1900 SW 4th Ave, Suite 5000
Portland, OR 97201



ELECTRICAL PERMIT

20-139775-000-00-ET

Site Address: 16427 NE AIRPORT WAY

Issued: 5/26/20

PROJECT INFORMATION		Occ. Group	Const. Type
Commercial/Multifamily	Addition/Alteration/Replacement		

Project Description: PDOX - 600 FEED TO 600 AMP PANEL, 150 kVA TRANSFORMER, AND 400 AMP

APPLICANT	JEREMY LORAAS	Phone:	(503) 781-1020
PROPERTY OWNER	16427 NE AIRPORT LLC	Phone:	
CONTRACTOR	M & M ELECTRICAL CONTRACTORS INC	Phone:	

Project Details		Project Details	
Branch Circuit with Svc/Fdr	1	Document Services - Bin Number	PDOX
Svc/Fdr 400 A&> with Fault Current >10000	Yes	Svc/Fdr 600 Amps or Greater	Yes
Svc/Fdr, 201 to 400 amps	1	Svc/Fdr, 401 to 600 amps	1

Prior to starting work on your site, you are responsible for verifying and complying with Zoning Code regulations (such as setbacks, screening and historic/design regulations). A land use review may be required. View the zoning code online (<http://www.portlandonline.com/zoningcode>), speak to a DSC Planner, or call 503-823-7526.

This permit expires if 180 days pass without an approved inspection. You may request a one-time only 180-day permit extension prior to the expiration date. If the permit is expired, you may request it be reactivated within 180 days of permit expiration date. If this permit is not reactivated, it becomes void and a new permit will be required to complete the work. For one- and two-family permits call 503-823-7388. For commercial permits call 503-823-7303.

BEFORE YOU DIG ATTENTION: Oregon law requires you to follow rules adopted by the Oregon Utility Notification Center. Those rules are set forth in OAR 952-001-0010 through OAR 952-001-0090. You may obtain copies of the rules by calling the center. (Note: the telephone number for the Oregon Utility Notification Center is 1-800-332-2344).

CITY CONTACT

E-Mail:

Phone:

Fax: (503) 823-4172

**INSPECTION REQUEST
PHONE NUMBERS**

Building/Trade Inspections - Call Before 6:00 AM: (503) 823-7000

TDD: (503) 823-6868


IVR Inspection Request
Number: 1544946

**Approved Except as Noted
Subject to the minimum
requirements of the
NEC., State of Oregon
Electrical Regulations
and Title 26 of the City
of Portland**

Date: 05/26/20

Project#: 20-139775-000-00-ET

Service 2 of 2

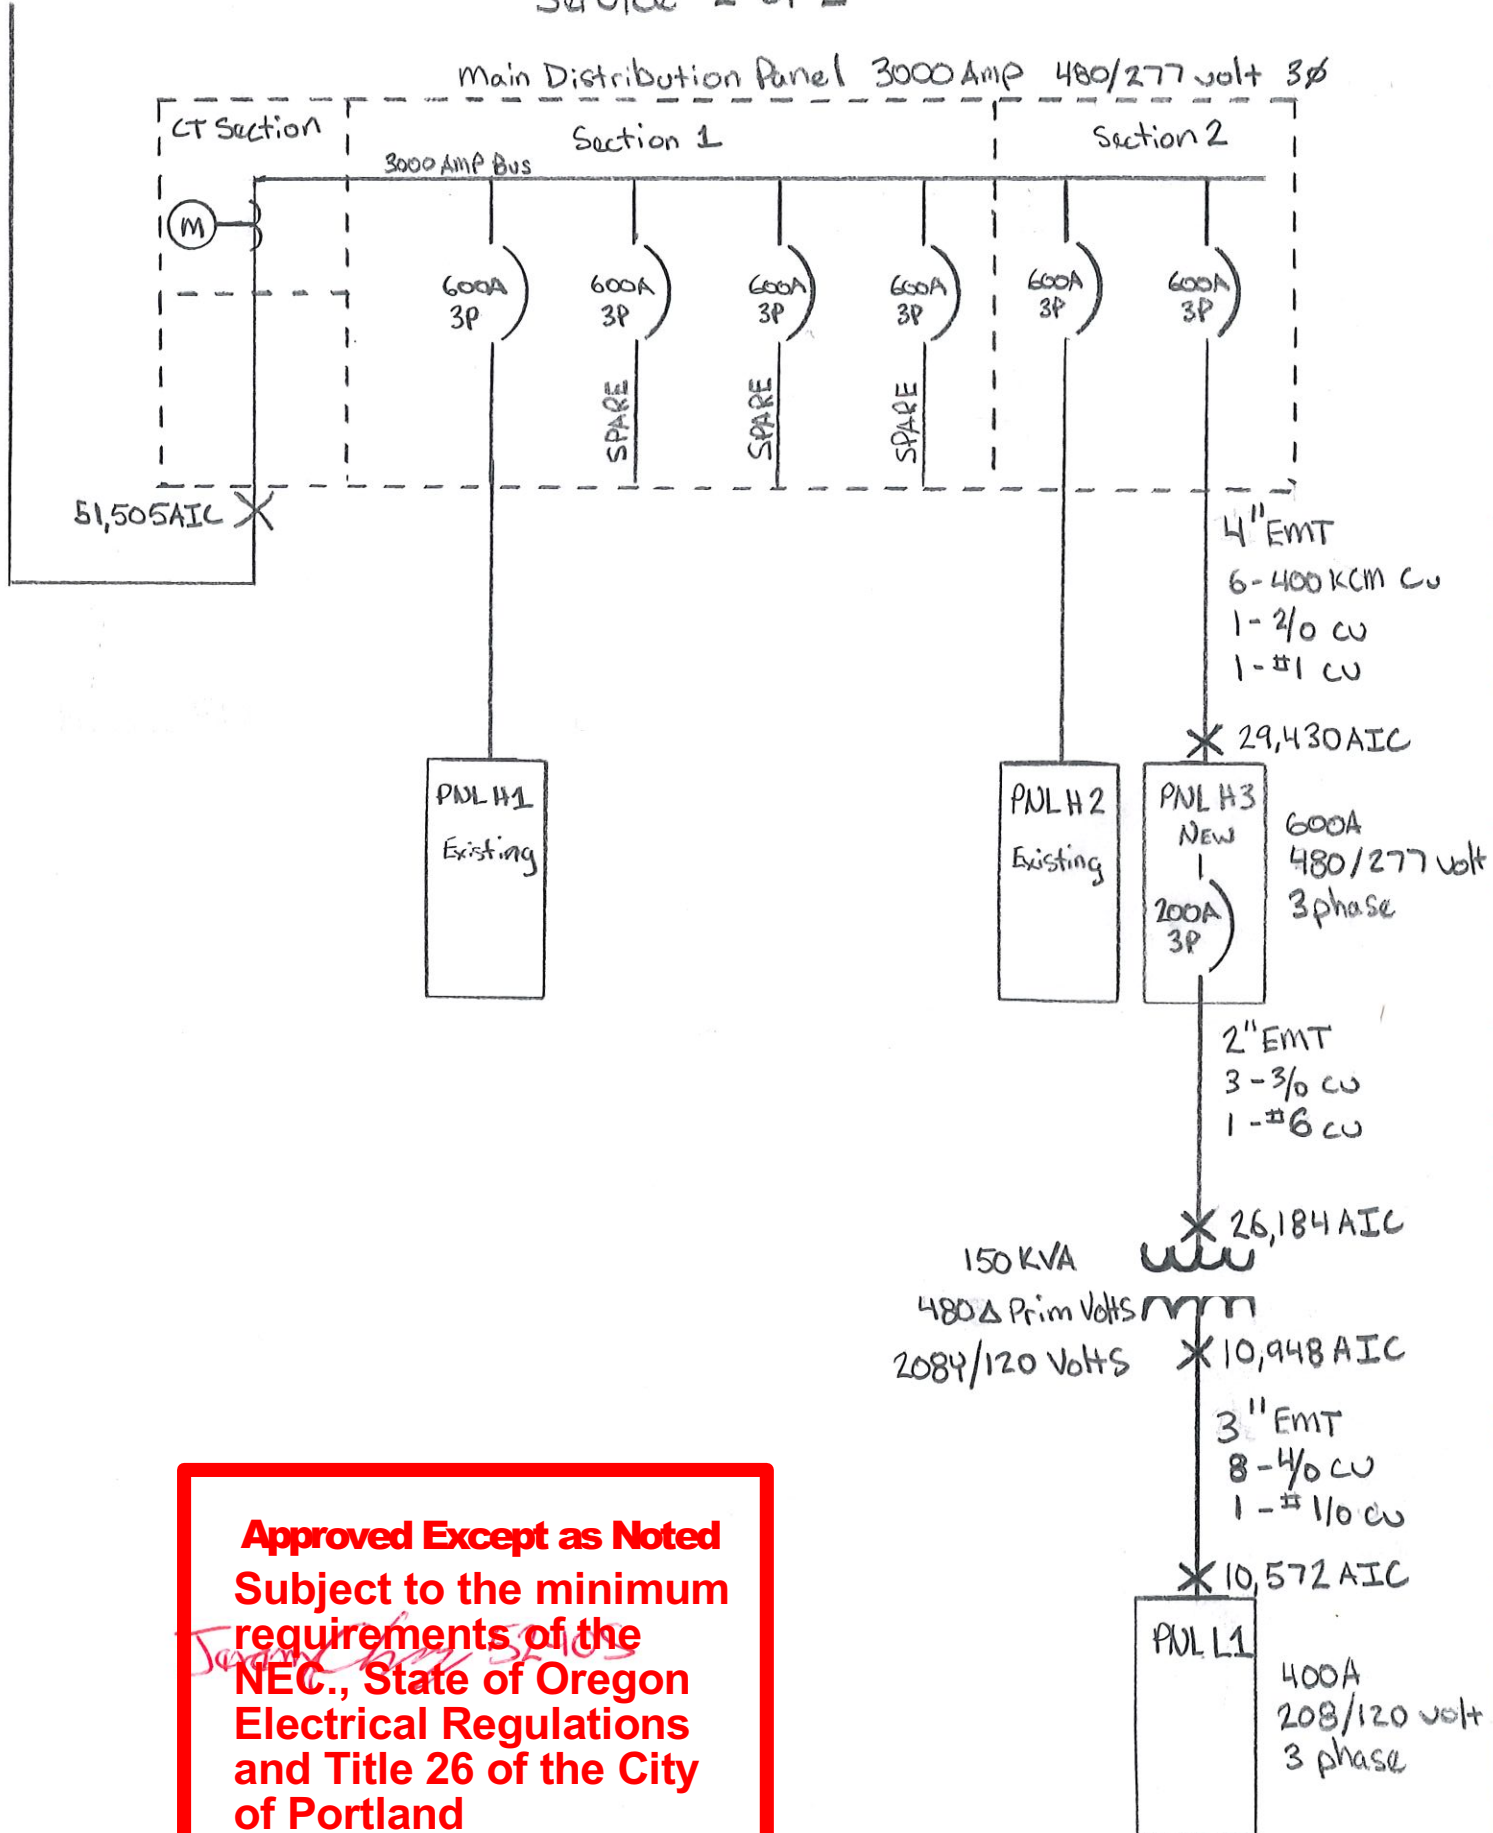

Approved Except as Noted
 Subject to the minimum
 requirements of the
 NEC., State of Oregon
 Electrical Regulations
 and Title 26 of the City
 of Portland

Date: 05/26/20

Project#: 20-139775-000-00-ET

Equipment Grounding Conductor

Neutral

Isolated Neutral Terminal

Panel H3 Bonded Terminal Bar

Water Bond

EGC

1/0 THW Co.

150 KVA Transformer

Bonded Terminal Bar

Panel L1 Bonded Ground Bar

Supply Side Bonding Jumper

Building Grounding Conductor

Building Grounding Conductor

Approved Except as Noted
Subject to the minimum
requirements of the
NEC., State of Oregon
Electrical Regulations
and Title 26 of the City
of Portland

Project#: 20-139775-000-00-ET

Date: 05/26/20
 Project#: 20-1397
 Jorany Chr 2-52405