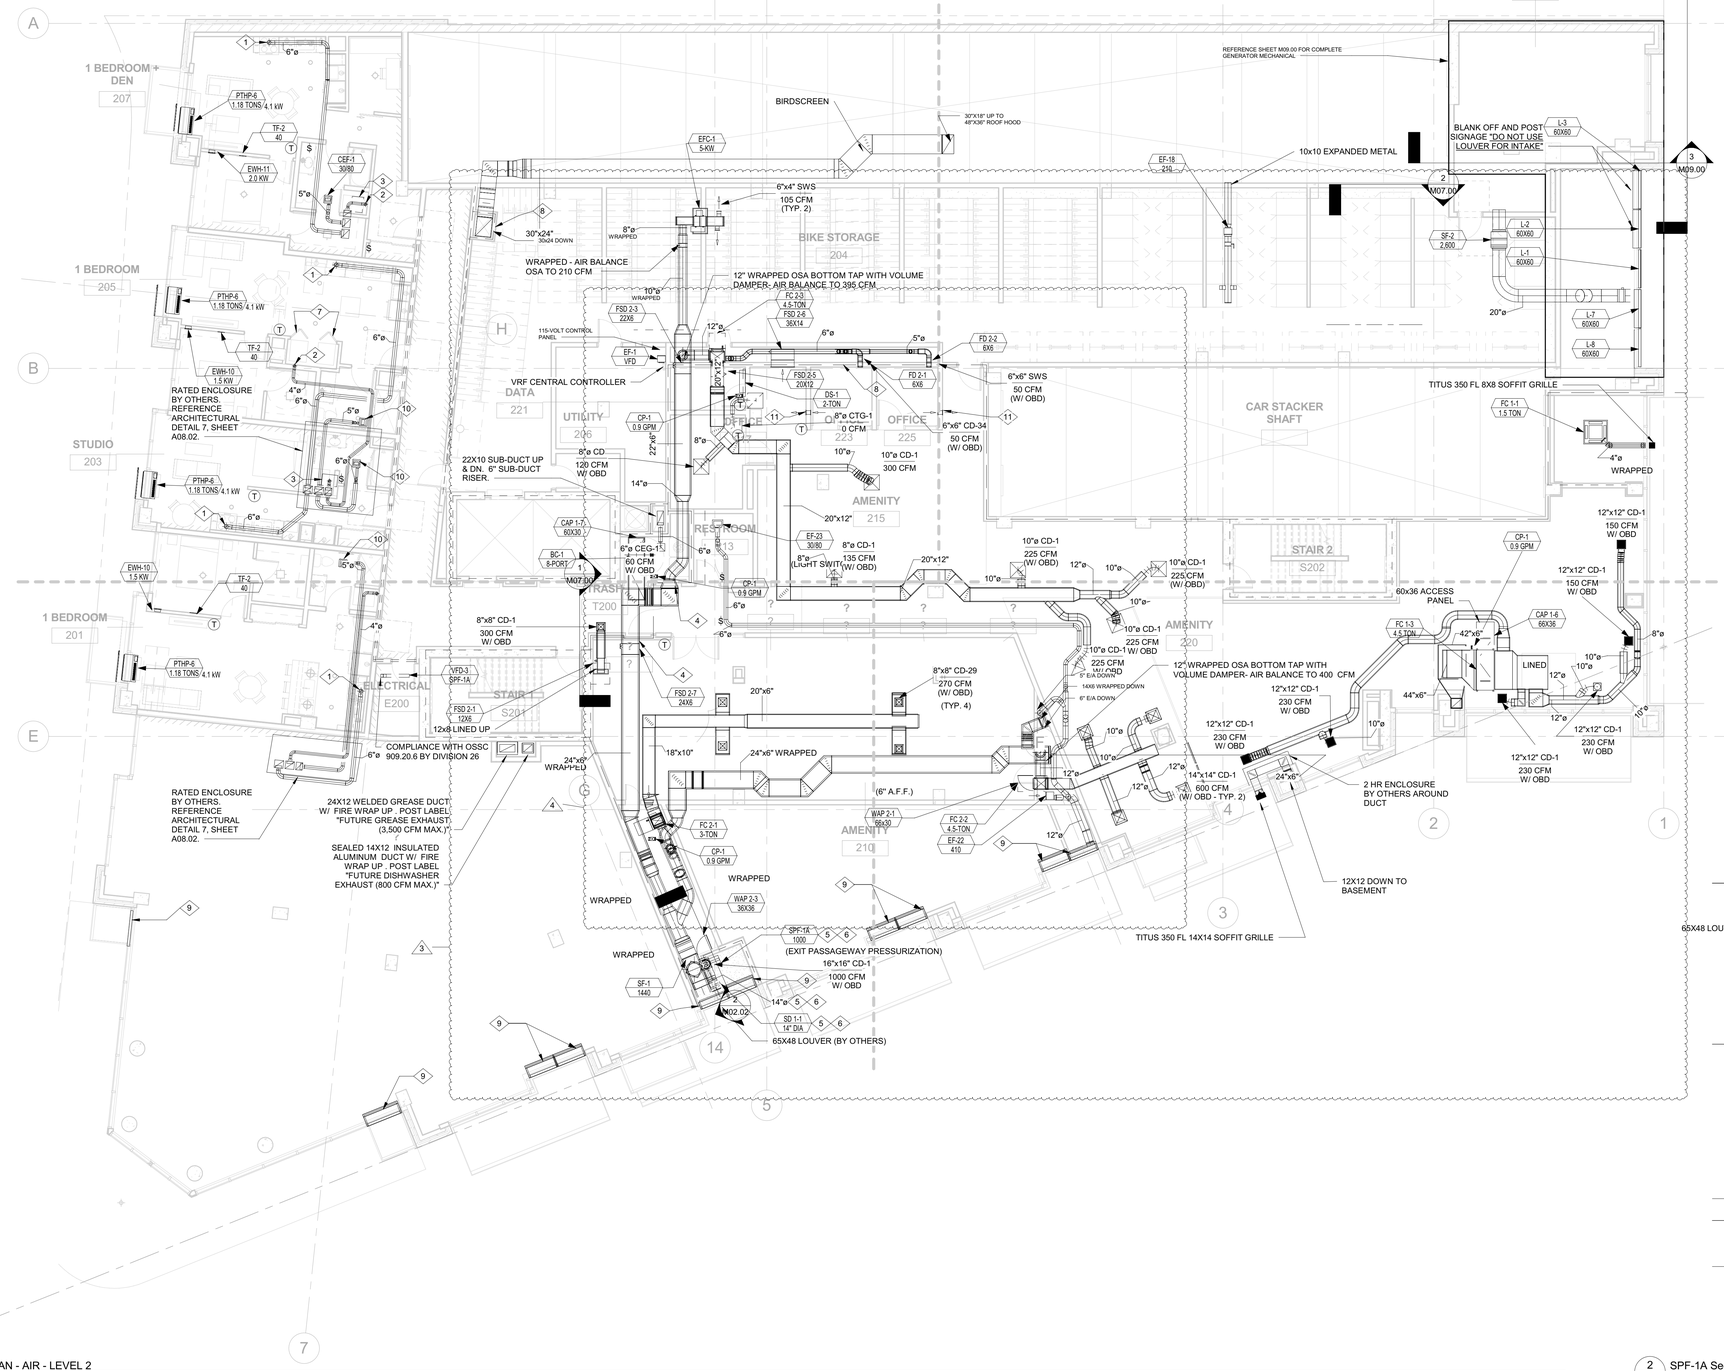

1 M02.02 HVAC PLAN - AIR - LEVEL 2
1/8" = 1'-0"

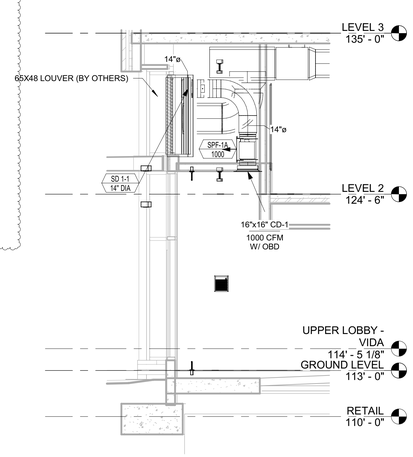

2 M02.02 SPF-1A Section
1/4" = 1'-0"

KEYNOTES	
1	AHI TO CONNECT TO OWNER SUPPLIED, INSTALLED BY OTHERS RANGE HOOD.
2	4" EXHAUST (DRYER VENT) DN TO OWNER PROVIDED DRYER.
3	24 x 18 RATED CEILING ACCESS BENEATH DRYER SUB-DUCT PANEL. LABEL CEILING ACCESS PANEL "FOR DRYER CLEAN-OUT".
4	NO FIRE DAMPER PER 2014 OMSC SECTION 607.5.2 EXCEPTION #3. DUCT TO BE FIRE CAULKED.
5	SPF-1A & ASSOCIATED DUCTWORK, CONTROL WIRING, POWER WIRING TO BE ENCLOSED IN A 2-HOUR FIRE-BARRIER CONSTRUCTION PER OSSC 909.20.6.1.
6	2 HOUR SEPARATION BY OTHERS.
7	DOOR LOUVER FOR DRYER EXHAUST MAKE-UP AIR ARE BY OTHERS.
8	1-HOUR FIRE BARRIER PER CODE COMPLIANCE SHEET G00.05.
9	WRAPPED LOUVER PLENUM. LOUVER BY OTHERS.
10	CEILING EXHAUST FAN CEF-1 / 30/70.
11	6 x 6 SIDE-WALL TRANSFER.

RATED WALL LEGEND (PER SHEET G00.05)

1-HOUR FIRE BARRIER

2-HOUR FIRE BARRIER

City Of Portland
REVIEWED FOR CODE COMPLIANCE
Date: 02/11/20
Project: 19-106743-REV-01-CO

American Heating, Inc.
PORTLAND, OREGON 97203-4495
TELEPHONE (503) 289-4600 FAX (503) 289-4605

08/23/18
B. SHEA
J. LOVELL
418308

REGISTERED PROFESSIONAL ENGINEER 49035PE OREGON JOSELITO G. AUSTRIA
EXPIRES: 12/31/19

18S
GREYSTAR
1715 SW Salmon St
Portland, OR 97205

REVISIONS

1	ADDENDUM 1	05/03/2019
A	PERMIT RESPONSE 1	06/03/2019
B	PERMIT RESPONSE 2	08/09/2019
C	PERMIT RESPONSE 3	09/18/2019
3	AB-01	09/27/2019
4	AB-02	11/01/2019

CHECKED BY: Checker
ISSUE DATE: 27 SEP 2019
PROJECT NO: 1803002

HVAC PLAN
LEVEL 2
M02.02

CONSTRUCTION SET

10/31/2019 3:08:09 PM