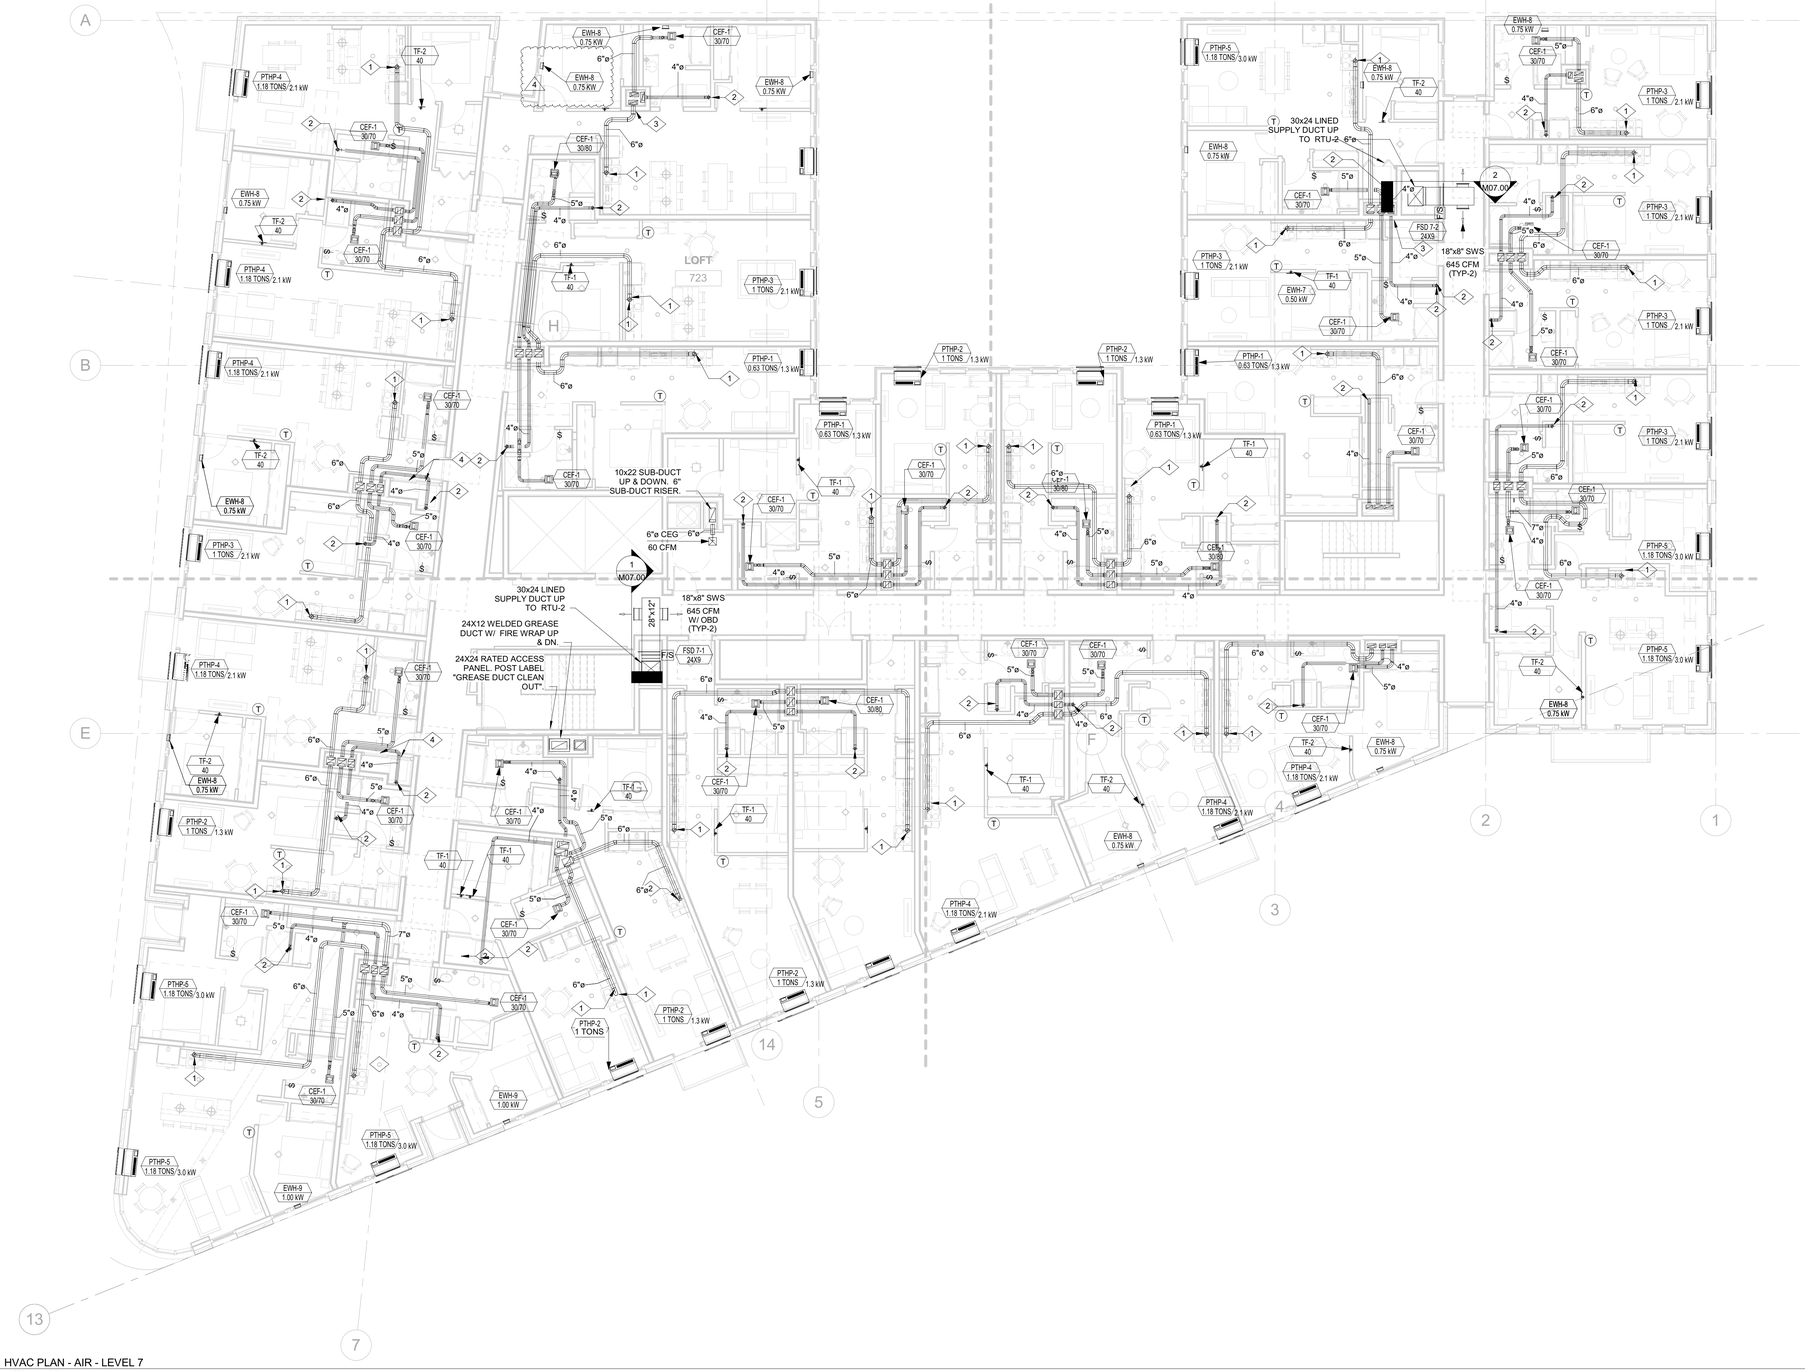

1 M02.07 HVAC PLAN - AIR - LEVEL 7
1/8" = 1'-0"

KEYNOTES	
1	AHI TO CONNECT TO OWNER SUPPLIED, INSTALLED BY OTHERS RANGE HOOD.
2	4" EXHAUST (DRYER VENT) DN TO OWNER PROVIDED DRYER.
3	24 x 18 RATED CEILING ACCESS BENEATH DRYER SUB-DUCT PANEL. LABEL CEILING ACCESS PANEL "FOR DRYER CLEAN-OUT".
4	DOOR LOUVER FOR DRYER EXHAUST MAKE-UP AIR ARE BY OTHERS.

City Of Portland

REVIEWED FOR CODE COMPLIANCE

Date: 02/11/20

Project: 19-106743-REV-01-CO

American Heating, Inc.
PO BOX 1000
PORTLAND, OR 97207-4295
TELEPHONE (503) 239-4600 FAX (503) 239-4605

08/23/18
B. SHEA
J. LOVELL
418308

THIS DRAWING IS THE PROPERTY OF AMERICAN HEATING, INC. IT IS PROVIDED FOR THE INSTALLATION OF EQUIPMENT PURCHASED FROM AMERICAN HEATING, INC. AND MAY NOT BE USED FOR ANY OTHER PURPOSE WITHOUT WRITTEN PERMISSION. ALL DIMENSIONS, CONDITIONS, AND DATA SHOWN ON THIS DRAWING MUST BE VERIFIED IN THE FIELD. ANY DEVIATIONS FROM THE INFORMATION SHOWN ON THIS DRAWING MUST BE REPORTED TO AMERICAN HEATING, INC. PRIOR TO INSTALLATION.

REGISTERED PROFESSIONAL ENGINEER
49035PE
OREGON
JOSELITO G. AUSTRIA
EXPIRES: 12/31/19

18S

GREYSTAR
1715 SW Salmon St
Portland, OR 97205

REVISIONS

A	PERMIT RESPONSE 1	06/03/2019
B	PERMIT RESPONSE 2	08/09/2019
3	AB-01	09/27/2019
4	AB-02	11/01/2019

CHECKED BY: Checker
ISSUE DATE: 27 SEP 2019
PROJECT NO: 1803002

HVAC PLAN LEVEL 7

M02.07

CONSTRUCTION SET

10/31/2019 3:08:57 PM