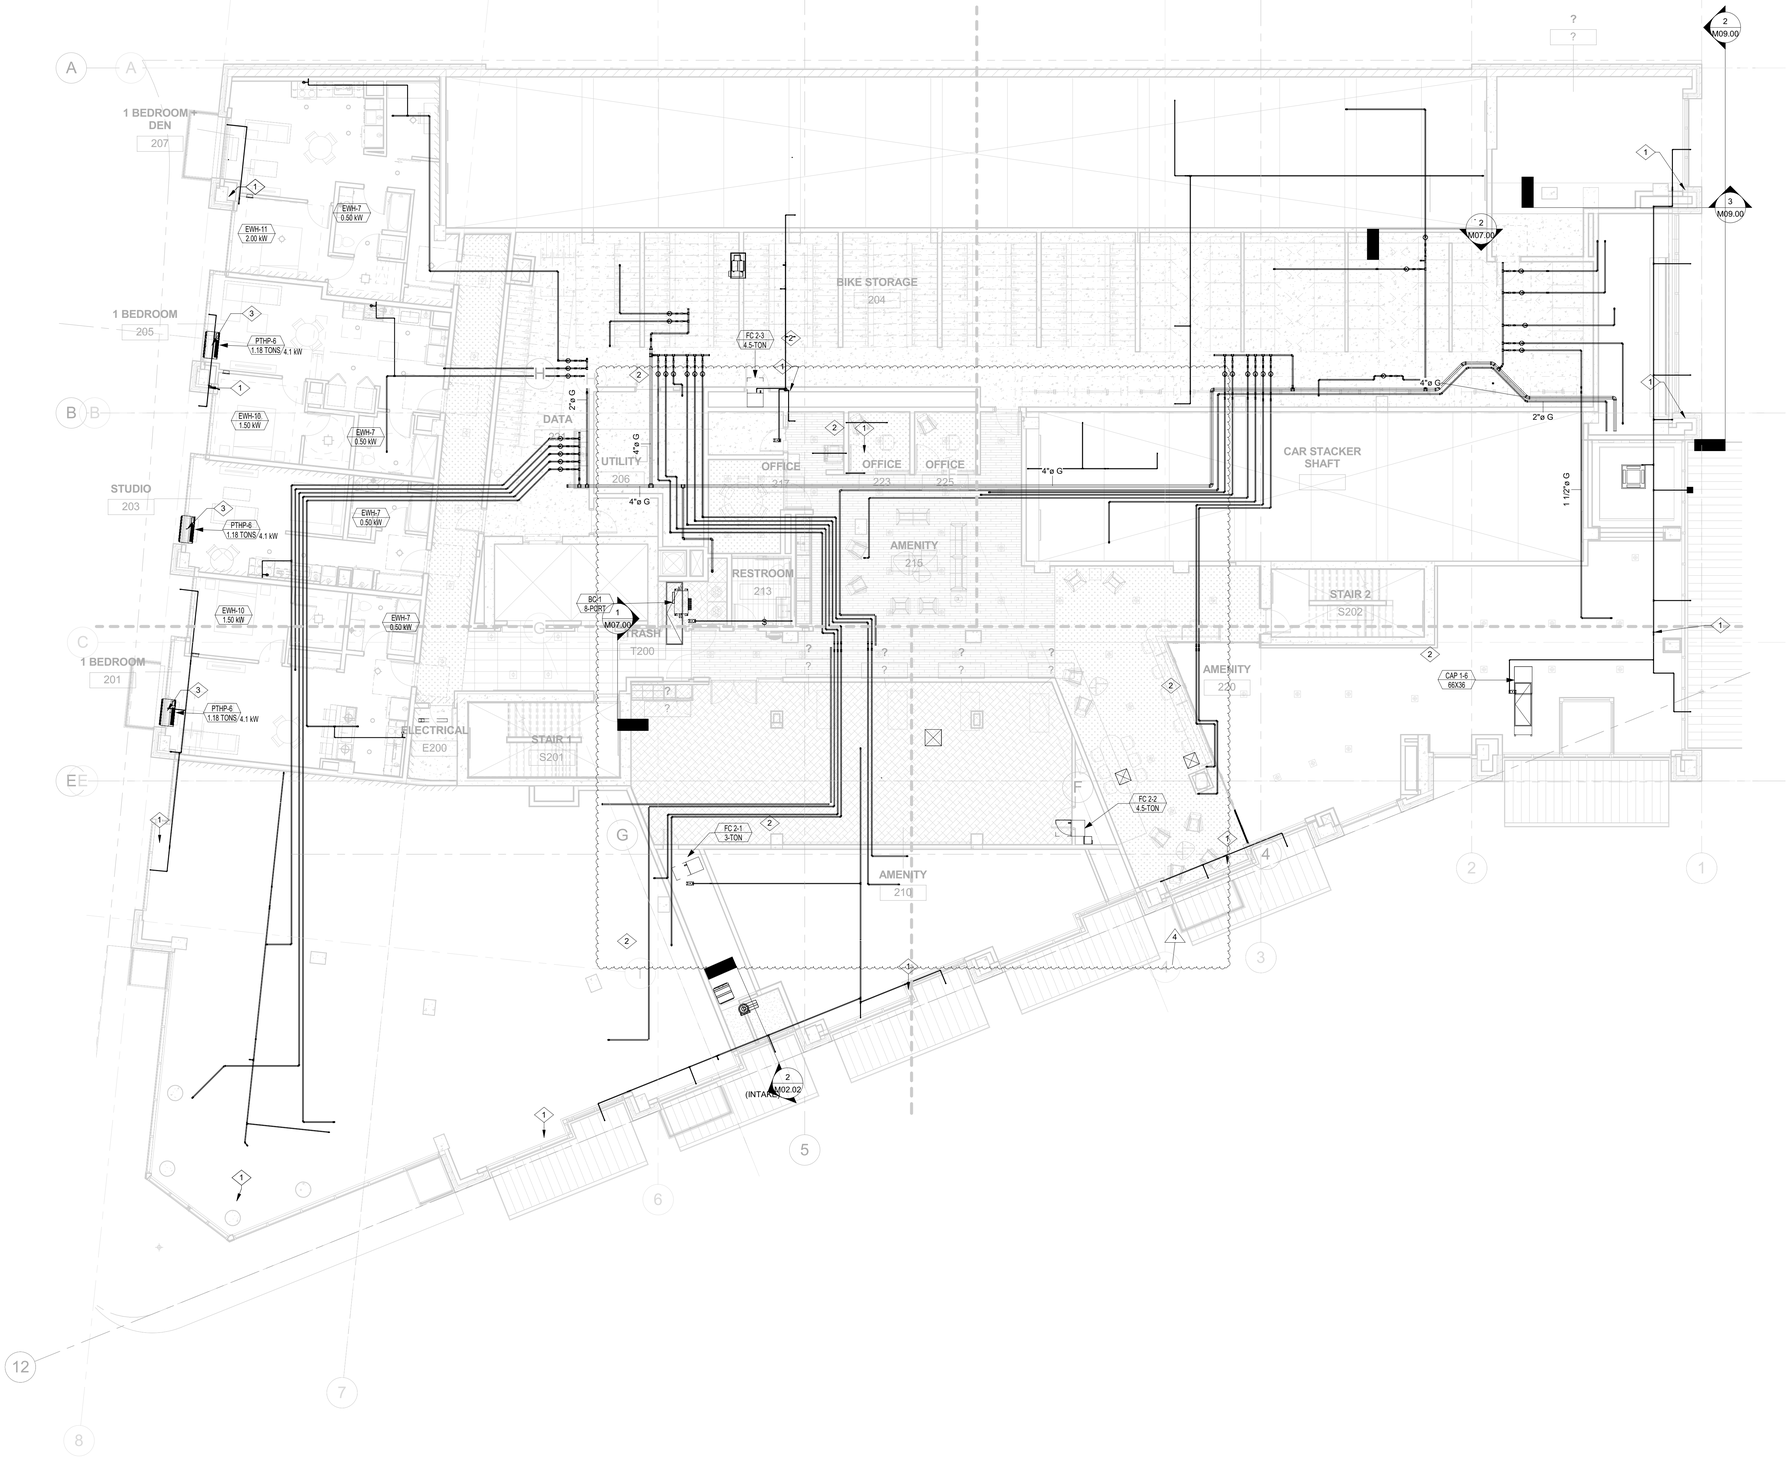

1 HVAC PLAN - PIPE - LEVEL 2
M03.02 1/8" = 1'-0"

KEYNOTES	
1	3/4" CONDENSATE DN FROM FLOOR ABOVE W/ 2" SLEEVE AND FIRE CAULKING. ROUTE TO FLOOR SINK IN UTILITY RM 206.
2	ROUTE CONDENSATE TO FLOOR SINK IN UTILITY ROOM 206.
3	RUN CONDENSATE THROUGH 2" SLEEVE & FIRE CAULKING SLEEVING THROUGH FLOOR / CEILING ASSEMBLY.

City Of Portland

REVIEWED FOR CODE COMPLIANCE

Date: 02/11/20

Project: 19-106743-REV-01-CO

American Heating, Inc.
PORTLAND, OREGON 97202-4295
TELEPHONE (503) 234-4600 FAX (503) 239-4600

08/23/18
B. SHEA
J. LOVELL
418308

REGISTERED PROFESSIONAL ENGINEER
49035PE
OREGON
JOSELITO G. AUSTRIA
EXPIRES: 12/31/19

18S
GREYSTAR
1715 SW Salmon St.
Portland, OR 97205

REVISIONS

A	PERMIT RESPONSE 1	06/03/2019
3	AB-01	09/27/2019
4	AB-02	11/01/2019



KEYPLAN

CHECKED BY: Checker
ISSUE DATE: 27 SEP 2019
PROJECT NO: 1803002

HVAC PIPE PLAN LEVEL 2

M03.02

CONSTRUCTION SET

10/31/2019 3:31:39 PM