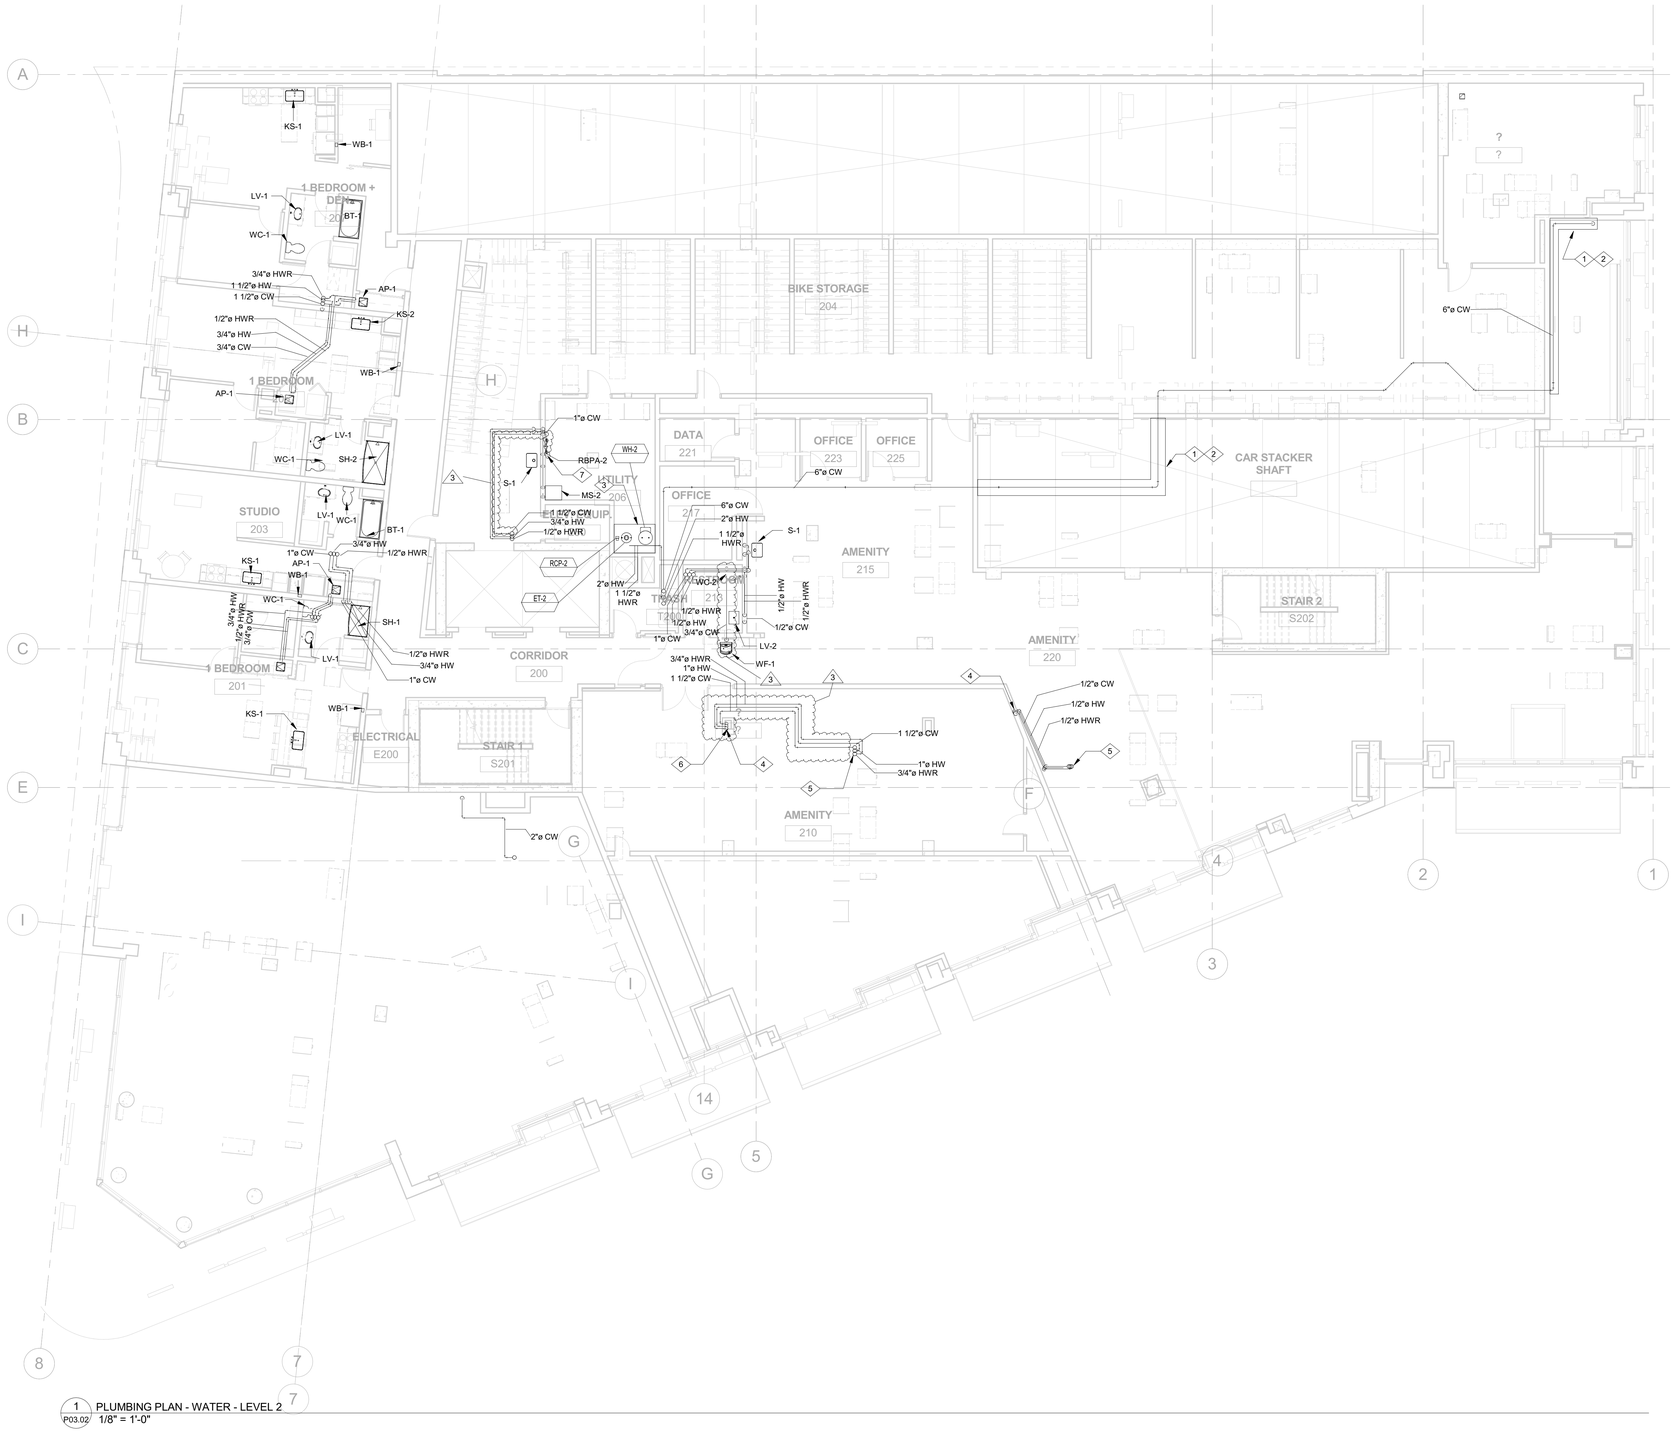


1 P03.02 PLUMBING PLAN - WATER - LEVEL 2
1/8" = 1'-0"

## SHEET NOTES

| | |
|---|---|
| 1 | IN RESIDENTIAL UNITS, PROVIDE SINGLE CW AND HW PIPES TO FIXTURES FROM RESPECTIVE MANIFOLDS. FIELD COORDINATE WITH OTHER TRADES. |
| 2 | ALL HOT WATER PIPING WHICH IS PART OF RECIRCULATION LOOP TO HAVE 1" INSULATION. |
| 3 | ACCESS PANEL PROVIDED BY AHI, INSTALLED BY OTHERS. |

## KEYNOTES

| | |
|---|---|
| 1 | HEAT TRACE REQUIRED - PROVIDED BY AHI, INSTALLED BY DIV 26. |
| 2 | ELECTRICAL TO PROVIDE 120V AC RECEPTACLE WITHIN 5FT FOR HEAT TRACING. |
| 3 | FOR PLUMBING DETAILS SEE P06.00 DETAIL 5. |
| 4 | RISER DROP TO FLOOR BELOW. |
| 5 | RISER UP TO FLOOR ABOVE. |
| 6 | 2 HOUR SEPARATION BY OTHERS. |
| 7 | P.O.C FOR IRRIGATION. |

**City Of Portland**

**REVIEWED FOR CODE COMPLIANCE**

Date: 02/11/20

Project: 19-106743-REV-01-CO


American Heating, Inc.
PORTLAND, OREGON 97202-4765
TELEPHONE (503) 239-4400 FAX (503) 239-4401


08/23/18
B. SHEA
J. LOVELL
418309

REGISTERED PROFESSIONAL ENGINEER 80947PE OREGON JAMES A. SCOTT LOVELL
DIGITALLY SIGNED
RENEWS: 12-31-2019

**18S**
GREYSTAR
1715 SW Salmon St
Portland, OR 97205

REVISIONS

| | | |
|---|---|---|
| A | PERMIT RESPONSE 1 | 06/03/2019 |
| 3 | AB-01 | 09/27/2019 |




KEYPLAN

CHECKED BY: Checker
ISSUE DATE: 27 SEP 2019
PROJECT NO: 1803002

**PLUMBING WATER PLAN LEVEL 2**

**P03.02**

**CONSTRUCTION SET**

10/31/2019 1:08:01 PM