


1 P06.00 DETAIL - PLUMBING LAV&WC 1




2 P06.00 DETAIL- PLUMBING LAV&WC 2

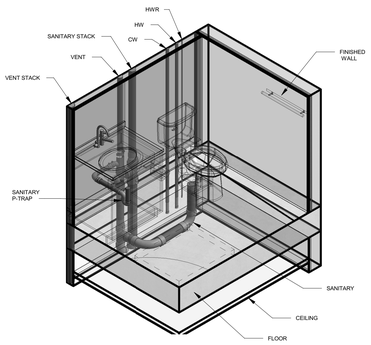


3 P06.00 DETAIL- PLUMBING AWB

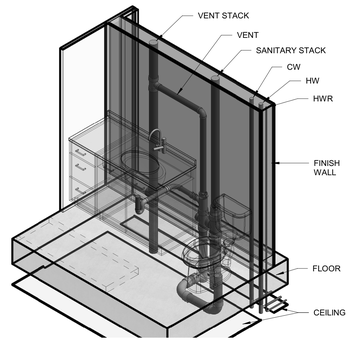


DETAIL NOTES

1. SEE FLOOR PLANS FOR CONTINUATION AND PIPE SIZE
2. SET WATER HEATER TEMPERATURE TO 140 °F
3. SET MMV-1 OUTLET TEMPERATURE TO 120 °F
4. BRACE WATER HEATER TO AS PER CODE AND INSTALLATION MANUAL

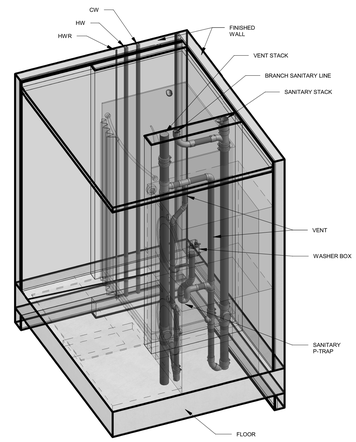4 P06.00 DETAIL - PLUMBING - ROOM 902
N.T.S.

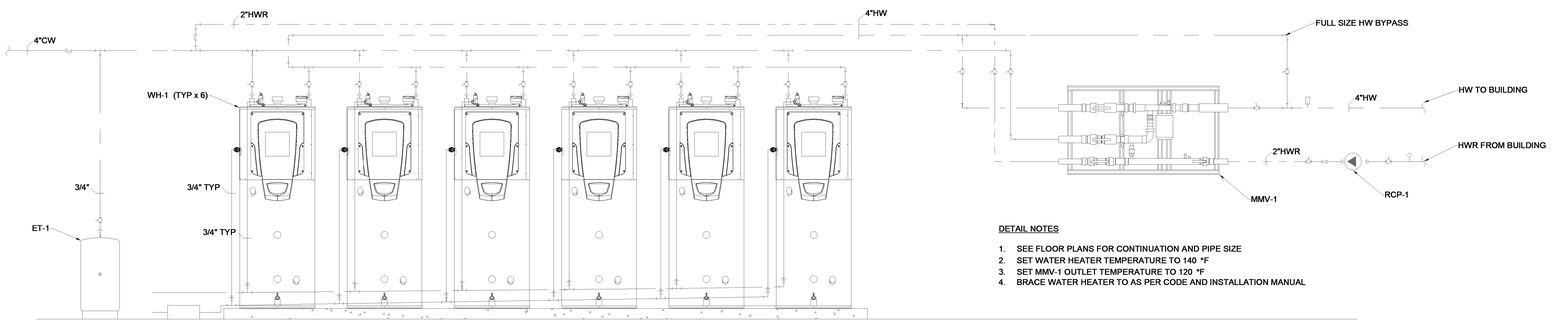


DETAIL NOTES

1. SEE FLOOR PLANS FOR CONTINUATION AND PIPE SIZE
2. SET WATER HEATER TEMPERATURE TO 120 °F
3. BRACE WATER HEATER TO AS PER CODE AND INSTALLATION MANUAL

5 P06.00 DETAIL - PLUMBING - UTILITY 206
N.T.S.

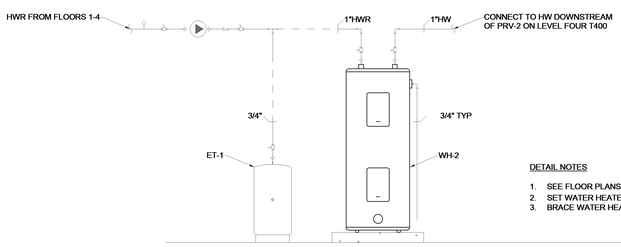


6 P06.00 DETAIL-PLIMBIGN GI

City Of Portland

REVIEWED FOR CODE COMPLIANCE

Date: 02/11/20

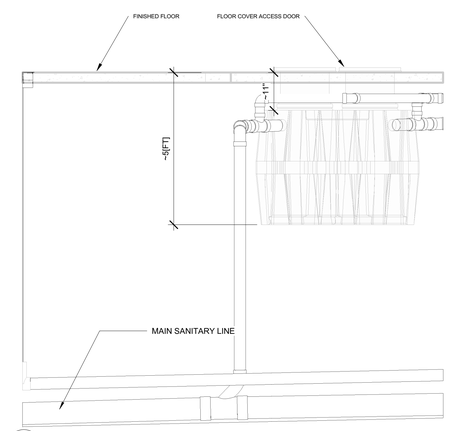Project: 19-106743-REV-01-CO

American Heating, Inc.
PORTLAND, OREGON 97202-4765
TELEPHONE (503) 239-4400 FAX (503) 239-4401

08/23/18
B. SHEA
J. LOVELL
418309

REGISTERED PROFESSIONAL ENGINEER 80947PE OREGON JAMES SCOTT FRANTZ

DIGITALLY SIGNED

RENEWS: 12-31-2019

NOT VALID UNLESS DIGITALLY SIGNED

18S
GREY'STAR
1715 SW Salmon St
Portland, OR 97205

REVISIONS

| | | |
|---|---|---|
| A | PERMIT RESPONSE 1 | 06/03/2019 |
| 3 | AB-01 | 09/27/2019 |

CHECKED BY: Checker
ISSUE DATE: 27 SEP 2019
PROJECT NO: 1803002

PLUMBING DETAILS

P06.00

CONSTRUCTION SET

10/31/2019 1:11:03 PM