

# Development Services

## From Concept to Construction

Phone: 503-823-7300 Email: [bds@portlandoregon.gov](mailto:bds@portlandoregon.gov) 1900 SW 4th Ave, Portland, OR 97201

More Contact Info (<http://www.portlandoregon.gov/bds/article/519984>)



### APPEAL SUMMARY

**Status:** Decision Rendered

<b>Appeal ID:</b> 16160	<b>Project Address:</b> 7184 N Vancouver Ave
<b>Hearing Date:</b> 11/22/17	<b>Appellant Name:</b> Tom Jaleski
<b>Case No.:</b> B-011	<b>Appellant Phone:</b> 5034885651
<b>Appeal Type:</b> Building	<b>Plans Examiner/Inspector:</b> Tara Carlson
<b>Project Type:</b> residential	<b>Stories:</b> 3 <b>Occupancy:</b> Townhouses <b>Construction Type:</b> V-B
<b>Building/Business Name:</b>	<b>Fire Sprinklers:</b> No
<b>Appeal Involves:</b> Erection of a new structure	<b>LUR or Permit Application No.:</b> 17-237861-CO
<b>Plan Submitted Option:</b> pdf [File 1]	<b>Proposed use:</b> Townhouses

### APPEAL INFORMATION SHEET

#### Appeal item 1

**Code Section** 2014 ORSC R302.2.7

**Requires** Townhouse exterior walls, privacy walls, common townhouse separation walls, exterior stairways, porches, porch coverings, decks, roofs and projections located within 3 feet of a common or property line shall be fire resistance rated and constructed in accordance with this section. Exception: Walls oriented perpendicular to a common property line need not be fire resistance rated construction and may have unprotected openings.

**Proposed Design** The proposed design for lots 2, 3, 4, 5, 7, 8, 9, 10, and 12 of the Origami Townhouses where windows on the exterior walls are less than 3 feet from the common property line and the walls are less than perpendicular to the common property line are as follows:  
The fixed windows will have a fire separation distance of at least 10 feet to the common property line, exceeding the requirement of Table R302.1.  
The walls within 3 feet on either side of the common property line will have a 1 hour rated assembly with non-combustible siding.

**Reason for alternative** The Origami townhouses are of Type VB construction and not sprinklered, as allowed per ORSC R302.2.5. The townhouses will meet the requirements of 2014 ORSC except that there are unprotected windows within 3 feet of the common property lines where the walls are less than perpendicular to the common property line.

The intent of R302.2.7 is to prevent fire and smoke from proceeding from one townhouse to the next one from a window on the exterior wall through the unprotected window. The code does have an exception when the building is sprinklered.

The proposed design is to provide 1 hour rated walls with non-combustible siding on the exterior walls and have the windows located so that the fire separation distance to the common property line is at least 10 feet. 2014 ORSC Table R302.1 allows unlimited quantity of unprotected windows where the fire separation distance is only 3 feet, much less than our proposed design. The walls where the windows are located have angles less than perpendicular, but greater than 70 degrees, and allows windows near the common property lines to have a fire separation distance of 10 feet to the common property line. The fire separation distance is defined in R202 as the distance from the building face at a right angle, to the closest lot line. The fire separation distance of the windows in the proposed design, as shown on the attached plans, is at least 10 feet from the edge of the window closest to the common property line. The exterior walls are 1 hour rated exterior wall assemblies as required per R302.2.6.1 with the additional protection of non-combustible siding. These assemblies will mitigate the potential for fire and smoke spread between townhouses. ORSC R302.2.6 and R302.2.7 are meant to prevent the spread of fire and smoke between townhouses where the walls are less than 90 degrees to the common property line. These code sections do not address the varying degrees of wall angle to the common property line. The code section is roughly based on testing by NIST in Technical Note 1600, attached, where parallel walls are tested with a fire separation distance of 3 feet. The openings in the test are directly in line with each other and the test shows that the window in the adjacent unit did not break until the temperature reached 1000 degrees Fahrenheit (560 C). The openings in the proposed design are oriented less than 15 degrees from perpendicular to the common property line and provide additional protection against the migration of fire and smoke between windows by having a fire separation distance of at least 10 feet. Table R302.1 allows unprotected openings with a fire separation distance of more than 3 feet. This is consistent with the NIST test where it showed that windows lined up and 6 feet from each other. The proposed design greatly exceeds the tested conditions in relation to angle between the openings and fire separation distance. The additional protection measure provided of fire separation distances of at least 10 feet, greatly exceeds the requirements of R302.1 and provides equivalent protection for the openings to not be impacted by a fire/smoke event in an adjacent townhouse.

The proposed design uses the 10 foot fire separation distance that exceeds requirements per ORSC Table 302.1 and is consistent with the OSSC allowance for fire rated walls to be protected only from fire from the inside of the building and unprotected openings on that wall. The non-combustible siding on the 1 hour rated wall further reduces the potential for fire spread from one townhouse to the adjacent townhouse. and request approval of this appeal.

---

## APPEAL DECISION

**Measurement of fire separation distance where wall openings are not perpendicular to the common property line: Granted as proposed with one hour exterior walls rated for exposure to fire from the inside and non combustibile siding.**

The Administrative Appeal Board finds that the information submitted by the appellant demonstrates that the approved modifications or alternate methods are consistent with the intent of the code; do not lessen health, safety, accessibility, life, fire safety or structural requirements; and that special conditions unique to this project make strict application of those code sections impractical.

Pursuant to City Code Chapter 24.10, you may appeal this decision to the Building Code Board of Appeal within 180 calendar days of the date this decision is published. For information on the appeals process and costs, including forms, appeal fee, payment methods and fee waivers, go to [www.portlandoregon.gov/bds/appealsinfo](http://www.portlandoregon.gov/bds/appealsinfo), call (503) 823-7300 or come in to the Development Services Center.

DRAWING SYMBOLS

	DIM.	DIMENSION: FROM FACE OF STUD, TYP.		PLAN DETAIL
		PROPERTY LINE		WATER HEATER (TANK)
		GRID LINE OR CENTER LINE		WATER HEATER (TANKLESS)
	100'	CONTOUR LINE		GAS SUPPLY W/ SHUTOFF
		HIDDEN LINE (OVERHEAD)		HOSE BIB
		HIDDEN LINE (BELOW)		SMOKE AND CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACK-UP AND INTERCONNECT
	+100'-0"	ELEVATION DATUM		ELECTRICAL PANEL
	ELEV 99'-2"	SPOT ELEVATION		HVAC SUPPLY AIR DUCT W/ GRILLE
	X	STRUCTURAL GRID TYPICALLY REFERENCES F.O. STUD/ F.O. CONCRETE UNLESS OTHERWISE NOTED		HVAC RETURN AIR DUCT W/ GRILLE
	#/A	TYPICAL DETAIL FLAG		ROUND AIR DUCT / EXHAUST
	#	DRAWING NUMBER		RECESSED CEILING EXHAUST FAN
	A	SHEET NUMBER		ELECTRIC RECESSED WALL-MOUNT HEATER
	#/A	EXTERIOR ELEVATION		DOWN SPOUT
	#/A	BUILDING SECTION		WALL TYPE
	#/A	WALL SECTION		WINDOW/DOOR TYPE
	#/A	SECTION DETAIL		

VICINITY MAP



ORIGAMI  
PERMIT SET  
JUNE 15, 2017



GENERAL NOTES

A. THE DRAWINGS REPRESENT DESIGN INTENT ONLY AND DO NOT NECESSARILY REFLECT EXACT FIELD CONDITION. THE CONTRACTOR IS RESPONSIBLE TO VERIFY THE CONDITIONS AND MEASUREMENTS OF THE EXISTING CONDITIONS PRIOR TO BEGINNING WORK OR ORDERING MATERIALS.

B. THE WORK PERFORMED UNDER THIS CONTRACT SHALL INCLUDE BUT IS NOT NECESSARILY LIMITED TO FURNISHING ALL LABOR, MATERIAL, ACCESSORIES, TOOLS, TRANSPORTATION, FEES, PERMITS AND TAXES TO COMPLETE THE WORK IN PLACE. COMPLETE. CONTRACTOR IS TO COORDINATE THE WORK OF THE VARIOUS ITEMS WHICH ARE FURNISHED BY THE OWNER OR FABRICATED, DELIVERED AND INSTALLED UNDER SEPARATE CONTRACTS.

C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SCHEDULING ALL REQUIRED INSPECTIONS BY THE LOCAL BUILDING DEPARTMENT HAVING JURISDICTION OVER THE PROJECT AND IN COORDINATING APPROVAL BY THE LOCAL GOVERNING HEALTH, FIRE, AND TRANSPORTATION DEPARTMENTS WHEN REQUIRED.

D. THE ARCHITECT HAS NO RESPONSIBILITY FOR WORK DONE UNDER SEPARATE CONTRACTS. CONTRACTOR IS RESPONSIBLE TO COORDINATE WORK BY SEPARATE CONTRACTS, INCLUDING BUT NOT LIMITED TO SUBMISSION OF DRAWINGS REQUIRED FOR THE BUILDING PERMIT, COORDINATION OF BIDDER-DESIGN WORK IN COMPLIANCE WITH REQUIREMENTS OF THE PROJECT, AND TO INSURE A QUALITY LEVEL OF WORK THAT MEETS OR EXCEEDS ACCEPTED BUILDING PRACTICES.

E. ALL WORK PERFORMED SHALL BE IN ACCORDANCE WITH THE INTERNATIONAL BUILDING CODE (CURRENT ADDITION) WITH LOCAL AMENDMENTS; APPLICABLE STATE, CITY AND COUNTY CODES, STATUTES, REGULATIONS, AND ORDINANCES.

F. IN THE EVENT OF A DISCREPANCY BETWEEN THE CONSTRUCTION DRAWINGS, SPECIFICATIONS, OR BUILDING CODE, NOTIFY THE ARCHITECT FOR FINAL CLARIFICATION BEFORE PROCEEDING WITH WORK.

G. NEITHER THE OWNER NOR THE ARCHITECT SHALL BE RESPONSIBLE FOR ANY EXTRA CHARGES OR COMPENSATION DUE TO DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THOSE INDICATED ON THE DRAWINGS. REPORT ANY DISCREPANCIES TO THE ARCHITECT FOR CONSIDERATION BEFORE PROCEEDING WITH WORK.

H. DIMENSIONS INDICATED ON THE DRAWINGS ARE TO FACE OF FRAMING UNLESS OTHERWISE NOTED.

I. DO NOT SCALE OFF THE DRAWINGS; IF NEEDED, THE ARCHITECT SHOULD BE CONSULTED FOR CLARIFICATION.

J. ANY DEVIATIONS FROM THE CONSTRUCTION DOCUMENTS SHALL BE COORDINATED WITH THE ARCHITECT. THE ARCHITECT SHALL BE EXEMPT FROM LIABILITY IF CHANGES IMPACT THE WORK AREA OR RELATED AREAS WITHOUT CONSENT AND WRITTEN APPROVAL. THE ARCHITECT SHALL HAVE FIVE (5) WORKING DAYS TO REVIEW SUCH SUBMITTALS.

K. CONTRACTOR TO PROVIDE ALL NECESSARY TEMPORARY SUPPORT FOR WALLS AND FLOORS PRIOR TO COMPLETION OF VERTICAL AND LATERAL LOAD SYSTEMS.

L. THE ARCHITECT HAS NO RESPONSIBILITY FOR ABATEMENT DESIGN, ABATEMENT DEMOLITION, ABATEMENT INSPECTION, ABATEMENT OBSERVATION, AND ACCIDENTAL EXPOSURE OR ANY OTHER MATTERS OF ANY KIND ARISING OUT OF, OR RELATING TO HAZARDOUS MATERIALS OF ANY KIND.

CODE INFORMATION

APPLICABLE CODES: 2014 OREGON RESIDENTIAL SPECIALTY CODE  
CITY OF PORTLAND CHAPTER 33 ZONING CODE

OCCUPANCY: RESIDENTIAL MULTI-FAMILY

ZONING INFORMATION

ZONING: R2  
LOT SIZE: .46 ACRES  
20,000 SQ FT (19,600 SQ FT AFTER DEDICATION)

MAX DENSITY: 10 UNITS (12 WITH AMENITY BONUS)  
MIN DENSITY: 8 UNITS  
MAX SITE COVERAGE (50%): 9,800 SQ FT (AFTER DEDICATION)  
MAX HEIGHT: 40'  
SETBACKS: FRONT: 10', SIDE & REAR: 5'-10' - SEE SITE PLAN, GARAGE:18'

INSULATION REQUIREMENTS

MIN. INSULATION REQUIREMENTS

PRESCRIPTIVE ENVELOPE REQUIREMENTS:

WALLS:	R-21	U=0.60
BELOW GRADE WALLS:	R-15	F=0.565
FLAT CEILINGS:	R-49	U=0.031
SLOPED CEILINGS:	R-38	U=0.042
UNDER FLOORS:	R-30	U=0.028
SLAB FLOOR EDGE:	R-15	F=0.520
HEATED SLAB INTERIOR:	R-10	
WINDOWS:	U=0.30	
SKYLIGHT (MAX 2% OF FLOOR AREA)	U=0.60	
EXTERIOR DOORS:	*U=0.20	
EXTERIOR DOORS > 2.5SF GLAZING:	U=0.40	
FORCED AIR DUCTS:	R-8	

\*MAX 28 SQ FT DOOR AREA PER DWELLING PERMITTED TO HAVE A U-FACTOR OF 0.54 OR LESS.

ADDITIONAL ENERGY EFFICIENCY REQUIREMENTS

ENVELOPE: **MEASURE 2**, HIGH EFFICIENCY ENVELOPE. EXTERIOR WALLS R-21 INTERMEDIATE FRAMING, VAULTED CEILINGS R-30 ADVANCED FRAMING, FLAT CEILINGS R-49 (N/A), FRAMED FLOORS R-38, WINDOWS U-0.30 AND ALL DOORS U-0.30 OR ADDITIONAL 15% OF PERMANENTLY INSTALLED LIGHTING FIXTURES AS HIGH-EFFICACY LAMPS OR CONSERVATION MEASURE D & E.

CONSERVATION: **MEASURE C**, DUCTLESS HEAT PUMP.

SPECIAL INSPECTIONS

SEE STRUCTURAL COVER SHEET.

DEFERRED SUBMITTALS

NONE.

PROJECT INFORMATION

SITE ADDRESS: 7120-7134 N VANCOUVER, PORTLAND, OR 97217  
PROPERTY ID: R208992  
TAX ROLL: LOVELEIGH, BLOCK 8, LOT 1-4  
COUNTY: MULTNOMAH  
STATE ID: 1N1E15AB 5100  
SITE AREA: 19,600 SQ FT

**Lot 1, Lot 11**  
SITE AREA: 1,600 SQ FT  
BUILDING AREA:  
GROUND: 141 SQ FT LIVING + 269 SQ FT GARAGE = 410 SQ FT  
SECOND: 493 SQ FT  
THIRD: 449 SQ FT  
TOTAL: 1,083 SQ FT LIVING  
BUILDING COVERAGE: 521 SQ FT (33% SITE AREA)  
IMPERMEABLE AREA: 493 SQ FT BUILDING  
482 SQ FT SHARED DRIVEWAY  
73 SQ FT OTHER CONCRETE  
TOTAL: 1,048 SQ FT IMPERMEABLE SURFACE (66% SITE AREA)

**Lot 2, Lot 12**  
SITE AREA: 1,600 SQ FT  
BUILDING AREA:  
GROUND: 278 SQ FT LIVING + 322 SQ FT ADU = 610 SQ FT  
SECOND: 656 SQ FT LIVING + 36 SQ FT PORCH = 692 SQ FT  
THIRD: 632 SQ FT  
TOTAL: 1,888 SQ FT LIVING  
BUILDING COVERAGE: 735 SQ FT (46% SITE AREA)  
IMPERMEABLE AREA: 735 SQ FT BUILDING  
222 SQ FT DRIVEWAY  
102 SQ FT OTHER CONCRETE  
TOTAL: 1,059 SQ FT IMPERMEABLE SURFACE (66% SITE AREA)

**Lot 3,4,5,7,8,9,10**  
SITE AREA: 1,612 SQ FT  
BUILDING AREA:  
GROUND: 523 SQ FT  
SECOND: 500 SQ FT  
THIRD: 487 SQ FT  
TOTAL: 1,510 SQ FT LIVING  
BUILDING COVERAGE: 573 SQ FT (36% SITE AREA)  
IMPERMEABLE AREA: 573 SQ FT BUILDING  
378 SQ FT SHARED DRIVEWAY  
282 SQ FT CONCRETE PARKING PAD  
43 SQ FT OTHER CONCRETE  
TOTAL: 1,276 SQ FT IMPERMEABLE SURFACE (79% SITE AREA)

**Lot 6**  
SITE AREA: 1,906 SQ FT  
BUILDING AREA:  
GROUND: 518 SQ FT  
SECOND: 520 SQ FT  
THIRD: 508 SQ FT  
TOTAL: 1,541 SQ FT LIVING  
BUILDING COVERAGE: 593 SQ FT (37% SITE AREA)  
IMPERMEABLE AREA: 593 SQ FT BUILDING  
447 SQ FT SHARED DRIVEWAY  
332 SQ FT CONCRETE PARKING PAD  
36 SQ FT OTHER CONCRETE  
TOTAL: 1,408 SQ FT IMPERMEABLE SURFACE (74% SITE AREA)

**TOTAL DEVELOPMENT**  
SITE AREA: 19,600 SQ FT  
BUILDING AREA:  
GROUND: 6,217 SQ FT  
SECOND: 6,318 SQ FT  
THIRD: 6,076 SQ FT  
TOTAL: 18,611 SQ FT LIVING  
BUILDING COVERAGE: 6,543 SQ FT (33% SITE AREA)  
IMPERMEABLE AREA: 6,543 SQ FT BUILDING  
4,123 SQ FT DRIVEWAY  
2,024 SQ FT CONCRETE PARKING PAD  
644 SQ FT OTHER CONCRETE  
TOTAL: 13,334 SQ FT IMPERMEABLE SURFACE (68% SITE AREA)

PROJECT TEAM

OWNER: 7120 VANCOUVER LLC  
STEPHEN GOMEZ  
1116 NW 17TH AVE  
PORTLAND, OR 97209  
503.819.8268  
STEPHEN@PROJECTPDX.COM

DEVELOPER: project^ PDX  
ANYELEY HALLOVA  
503.922.0056  
RY@CANOPYNW.COM

ARCHITECT: WAECHTER ARCHITECTURE  
BEN WAECHTER, AIA, NCARB  
503.894.9480  
BEN@BENWAECHTER.COM

STRUCTURAL ENGINEER: GRUMMEL ENGINEERING LLC  
ALEX GRUMMEL, P.E.  
503.244.7014  
ALEX@GRUMMELENGINEERING.COM

CIVIL ENGINEER: KPFF PORTLAND CIVIL & SURVEY  
JOSH LIGHTHIPE  
503.542.3860  
JOSH.LIGHTHIPE@KPFF.COM

LANDSCAPE: LANGO HANSEN LANDSCAPE ARCHITECTS  
JANE HANSEN  
503.295.2437  
JANE@LANGOHANSEN.COM

GEO-TECH CONSULTANT: GEO PACIFIC ENGINEERING, INC  
JAMES IMBRIE, G.E., C.E.G.  
503.598.8445

CONTRACTOR: LMC CONSTRUCTION  
SCOTT DEKKER  
503.915.7126  
SCOTT@LMCCONSTRUCTION.COM

PROJECT SUMMARY

12 SINGLE FAMILY RESIDENCES ON INDIVIDUAL LOTS CREATED THROUGH LAND DIVISION, 2 DETACHED AND 10 ATTACHED

RELATED PERMITS

2016-204690-000-00-RS SINGLE FAMILY DWELLING RESIDENTIAL 1 & 2 FAMILY DEMO  
2016-287694-000-00-LU TYPE 3 LAND USE REVIEW - LDS  
2016-287694-000-00-FP FINAL PLAT  
2017-137295-000-00-WT PDOT PUBLIC WORKS, TRANSPORTATION BUREAU MODERATE

DRAWING INDEX

**ARCHITECTURAL**  
A0.0 COVER / INFORMATION  
A0.1 WINDOW TYPES  
A0.2 ASSEMBLY TYPES  
A1.1 SITE PLAN  
A1.2 SITE MATERIALS PLAN  
A2.0 ARCH. FOUNDATION PLAN - NORTH  
A2.1 ARCH. FOUNDATION PLAN - SOUTH  
A2.2 PLAN LEVEL 1 - NORTH  
A2.3 PLAN LEVEL 1 - SOUTH  
A2.4 PLAN LEVEL 2 - NORTH  
A2.5 PLAN LEVEL 2 - SOUTH  
A2.6 PLAN LEVEL 3 - NORTH  
A2.7 PLAN LEVEL 3 - SOUTH  
A2.8 ATTIC PLAN - NORTH  
A2.9 ATTIC PLAN - SOUTH  
A2.10 ROOF PLAN - NORTH  
A2.11 ROOF PLAN - SOUTH  
A3.1 BUILDING SECTIONS  
A3.2 BUILDING SECTIONS  
A3.3 BUILDING SECTIONS  
A3.4 BUILDING SECTIONS  
A3.5 BUILDING SECTIONS  
A4.1 BUILDING ELEVATIONS  
A4.2 BUILDING ELEVATIONS  
A4.3 BUILDING ELEVATIONS  
A4.4 BUILDING ELEVATIONS  
A4.5 BUILDING ELEVATIONS  
A8.1 FOUNDATION DETAILS  
A8.2 FRAMING DETAILS  
A8.3 SIDING & ROOF DETAILS  
A8.4 WINDOW/DOOR DETAILS  
A8.5 WINDOW/DOOR DETAILS  
A9.1 INTERIOR DETAILS

**STRUCTURAL**  
S0.0 GENERAL NOTES  
S1.1 FOUNDATION PLAN AT NORTH SIDE  
S1.2 FOUNDATION PLAN AT SOUTH SIDE  
S1.3 SECOND FLOOR PLAN AT NORTH SIDE  
S1.4 SECOND FLOOR PLAN AT SOUTH SIDE  
S1.5 THIRD FLOOR PLAN AT NORTH SIDE  
S1.6 THIRD FLOOR PLAN AT SOUTH SIDE  
S1.7 ROOF PLAN AT NORTH SIDE  
S1.8 ROOF PLAN AT SOUTH SIDE  
S2.1 ELEVATIONS  
S2.2 ELEVATIONS  
S2.3 ELEVATIONS  
S3.1 DETAILS  
S3.2 DETAILS  
S3.3 DETAILS

**CIVIL**  
C0.1 COVER SHEET  
C0.2 EXISTING CONDITIONS PLAN  
C1.0 DEMOLITION PLAN  
C2.1 SITE PLAN  
C3.1 GRADING PLAN  
C3.2 GRADING PLAN - NORTH  
C3.3 GRADING PLAN - SOUTH  
C3.4 GRADING PLAN  
C4.1 UTILITY PLAN  
C4.2 UTILITY STRUCTURE TABLES  
C5.1 DETAILS  
C5.2 DETAILS  
C6.1 EROSION AND SEDIMENT CONTROL PLAN  
C6.2 EROSION AND SEDIMENT CONTROL DETAILS

**LANDSCAPE**  
L0.01 TREE REMOVAL PLAN  
L1.01 PLANTING PLAN  
L2.01 LANDSCAPE DETAILS

**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

ORIGAMI

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS	DATE:
NUMBER:	


PERMIT SET

DATE: 6.15.2017

COVER

A0.0



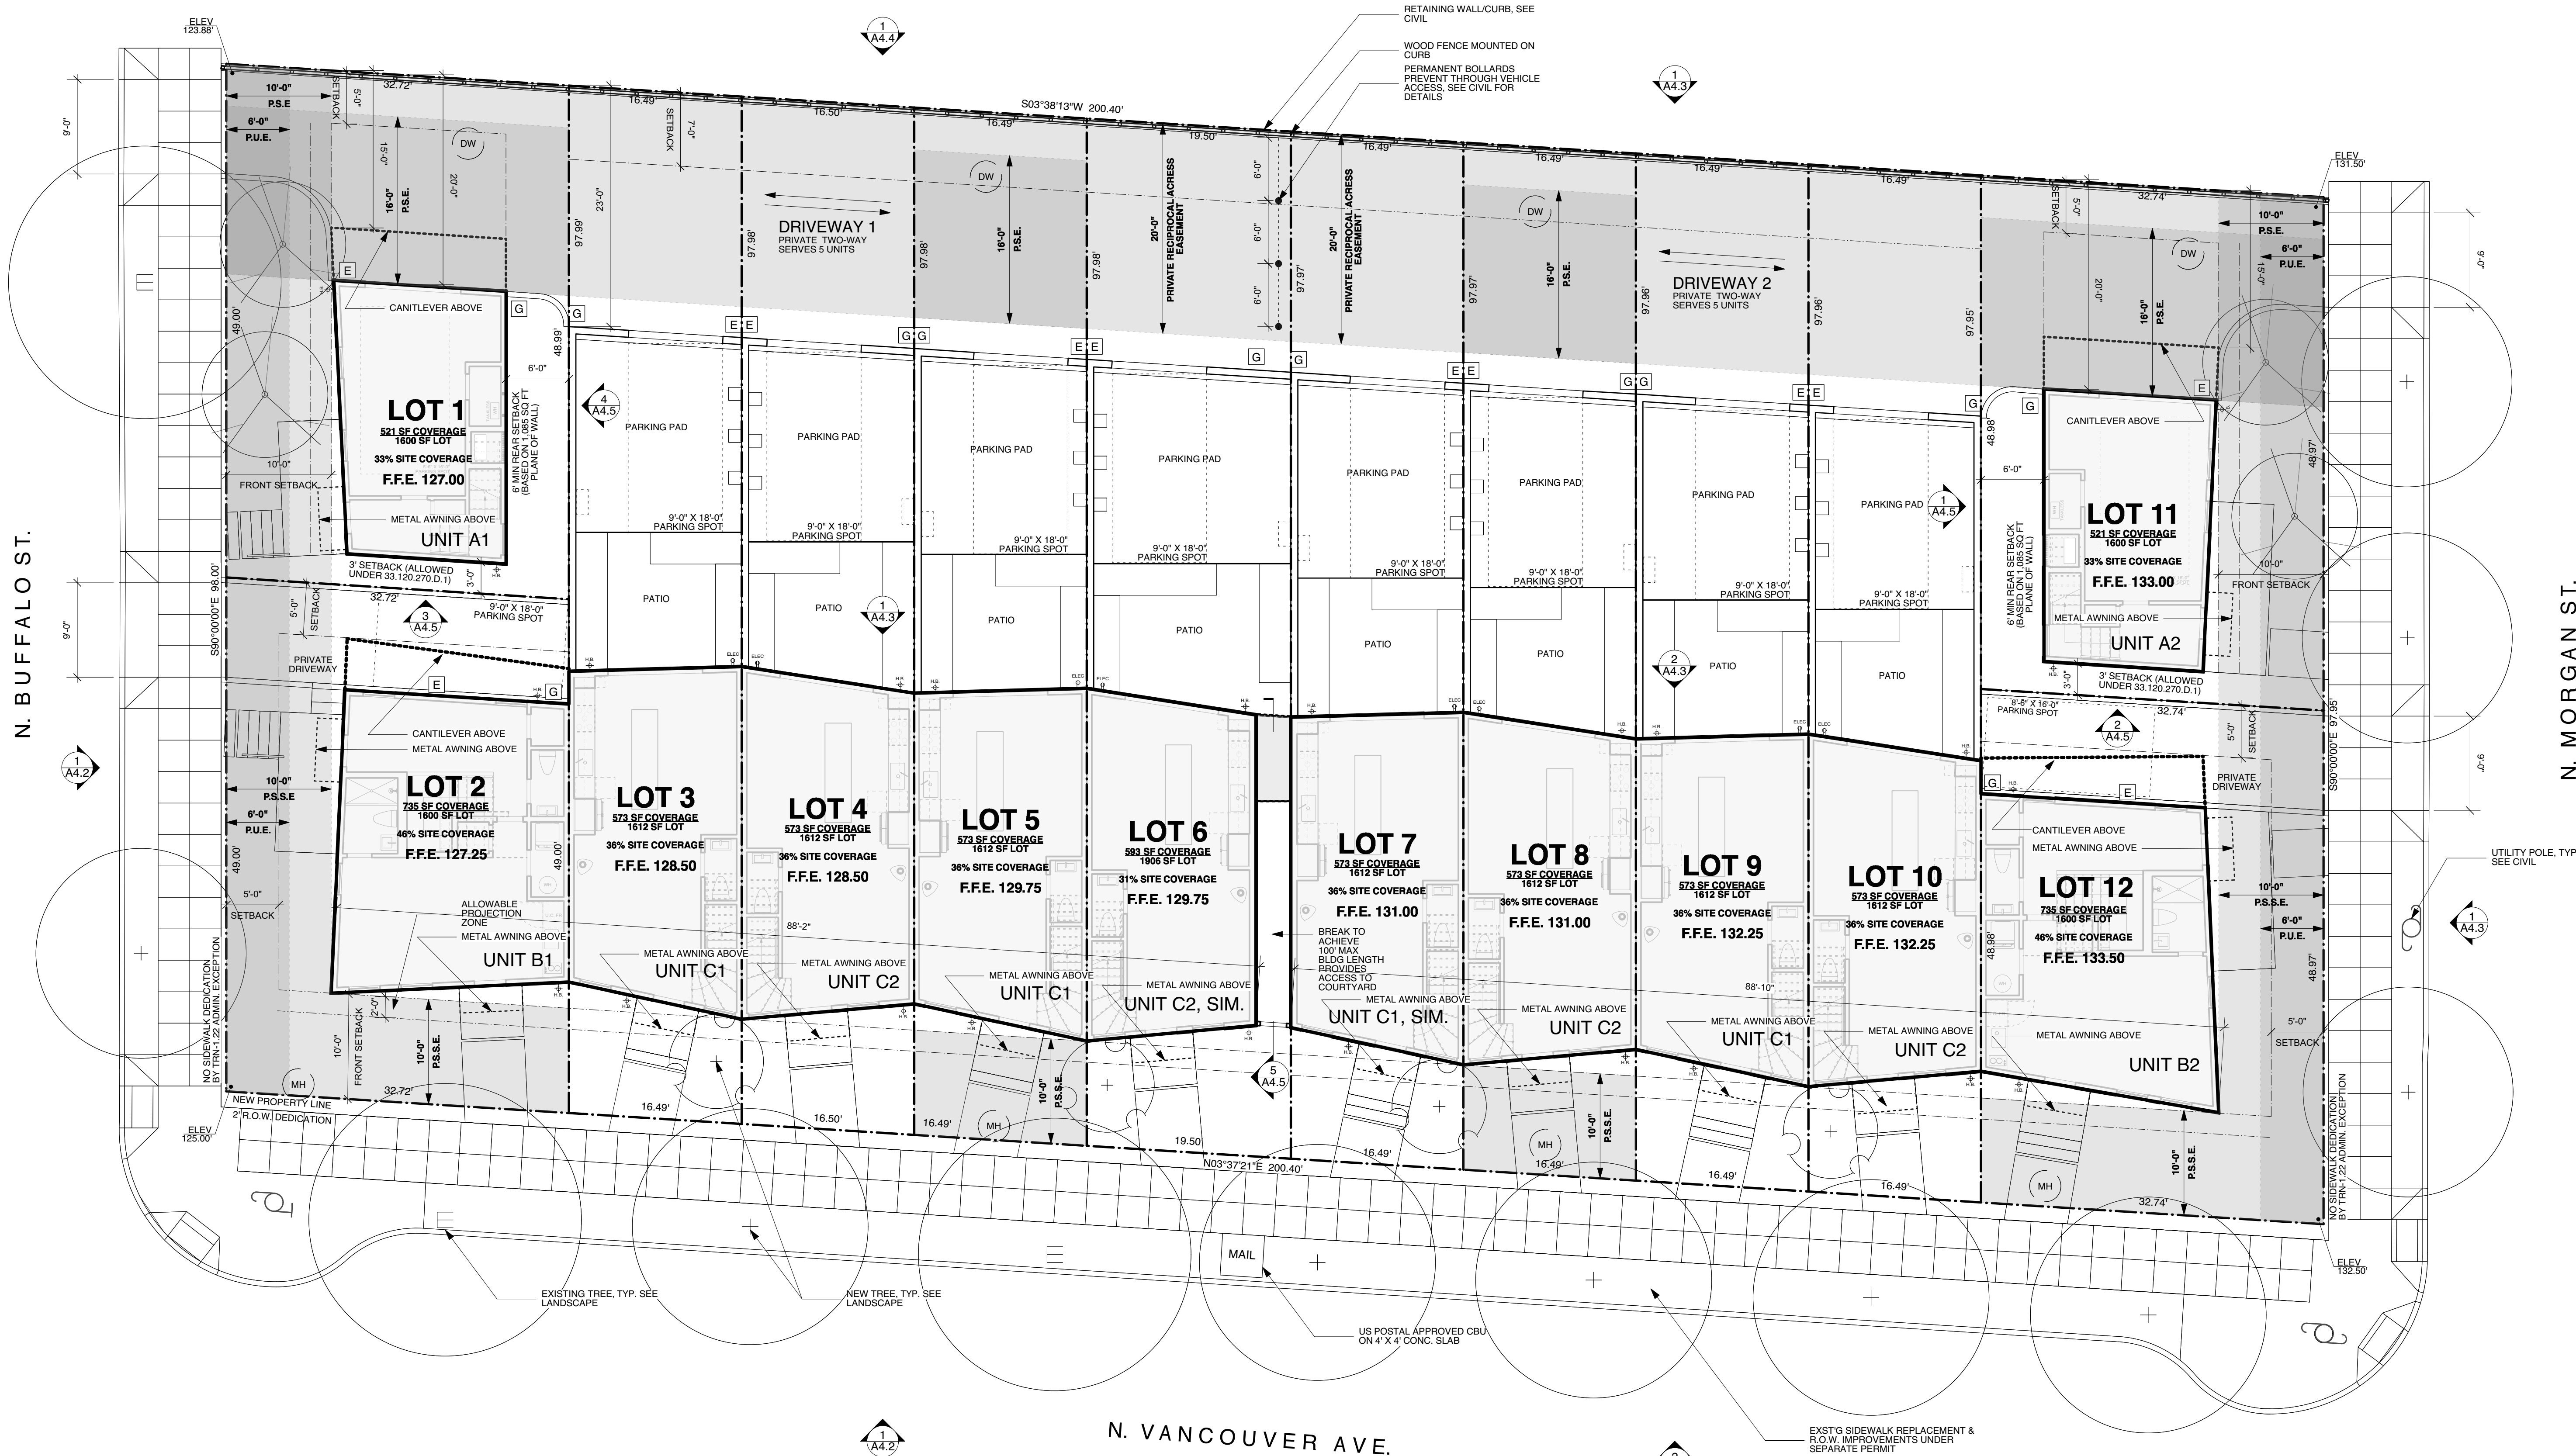

### GENERAL NOTES

SEE CIVIL C4.1 FOR SITE UTILITIES AND STORM DRAIN PLAN

SEE CIVIL C3.1-C3.4 FOR SITE GRADING

SEE LANDSCAPE L1.01 FOR PLANTING PLAN AND STREET TREES & EXST'G TREE PROTECTION

### KEY

P.U.E. PUBLIC UTILITY EASEMENT  
P.S.E. PRIVATE STORM SEWER EASEMENT  
P.S.S.E. PRIVATE SANITARY SEWER EASEMENT  
--- PROPERTY LINE  
--- REQUIRED BUILDING SETBACK  
--- UTILITY/ACCESS EASEMENT

DW DRYWELL, SEE CIVIL  
MH SANITARY MANHOLE, SEE CIVIL  
E ELECTRIC METER, SEE CIVIL  
G GAS METER, SEE CIVIL

### 1. SITE PLAN

SCALE: 1/8" = 1'-0"



**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

### ORIGAMI

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS  
NUMBER: DATE:  
1 10.11.2017


### PERMIT SET

DATE: 6.15.2017

### SITE PLAN

# A1.1



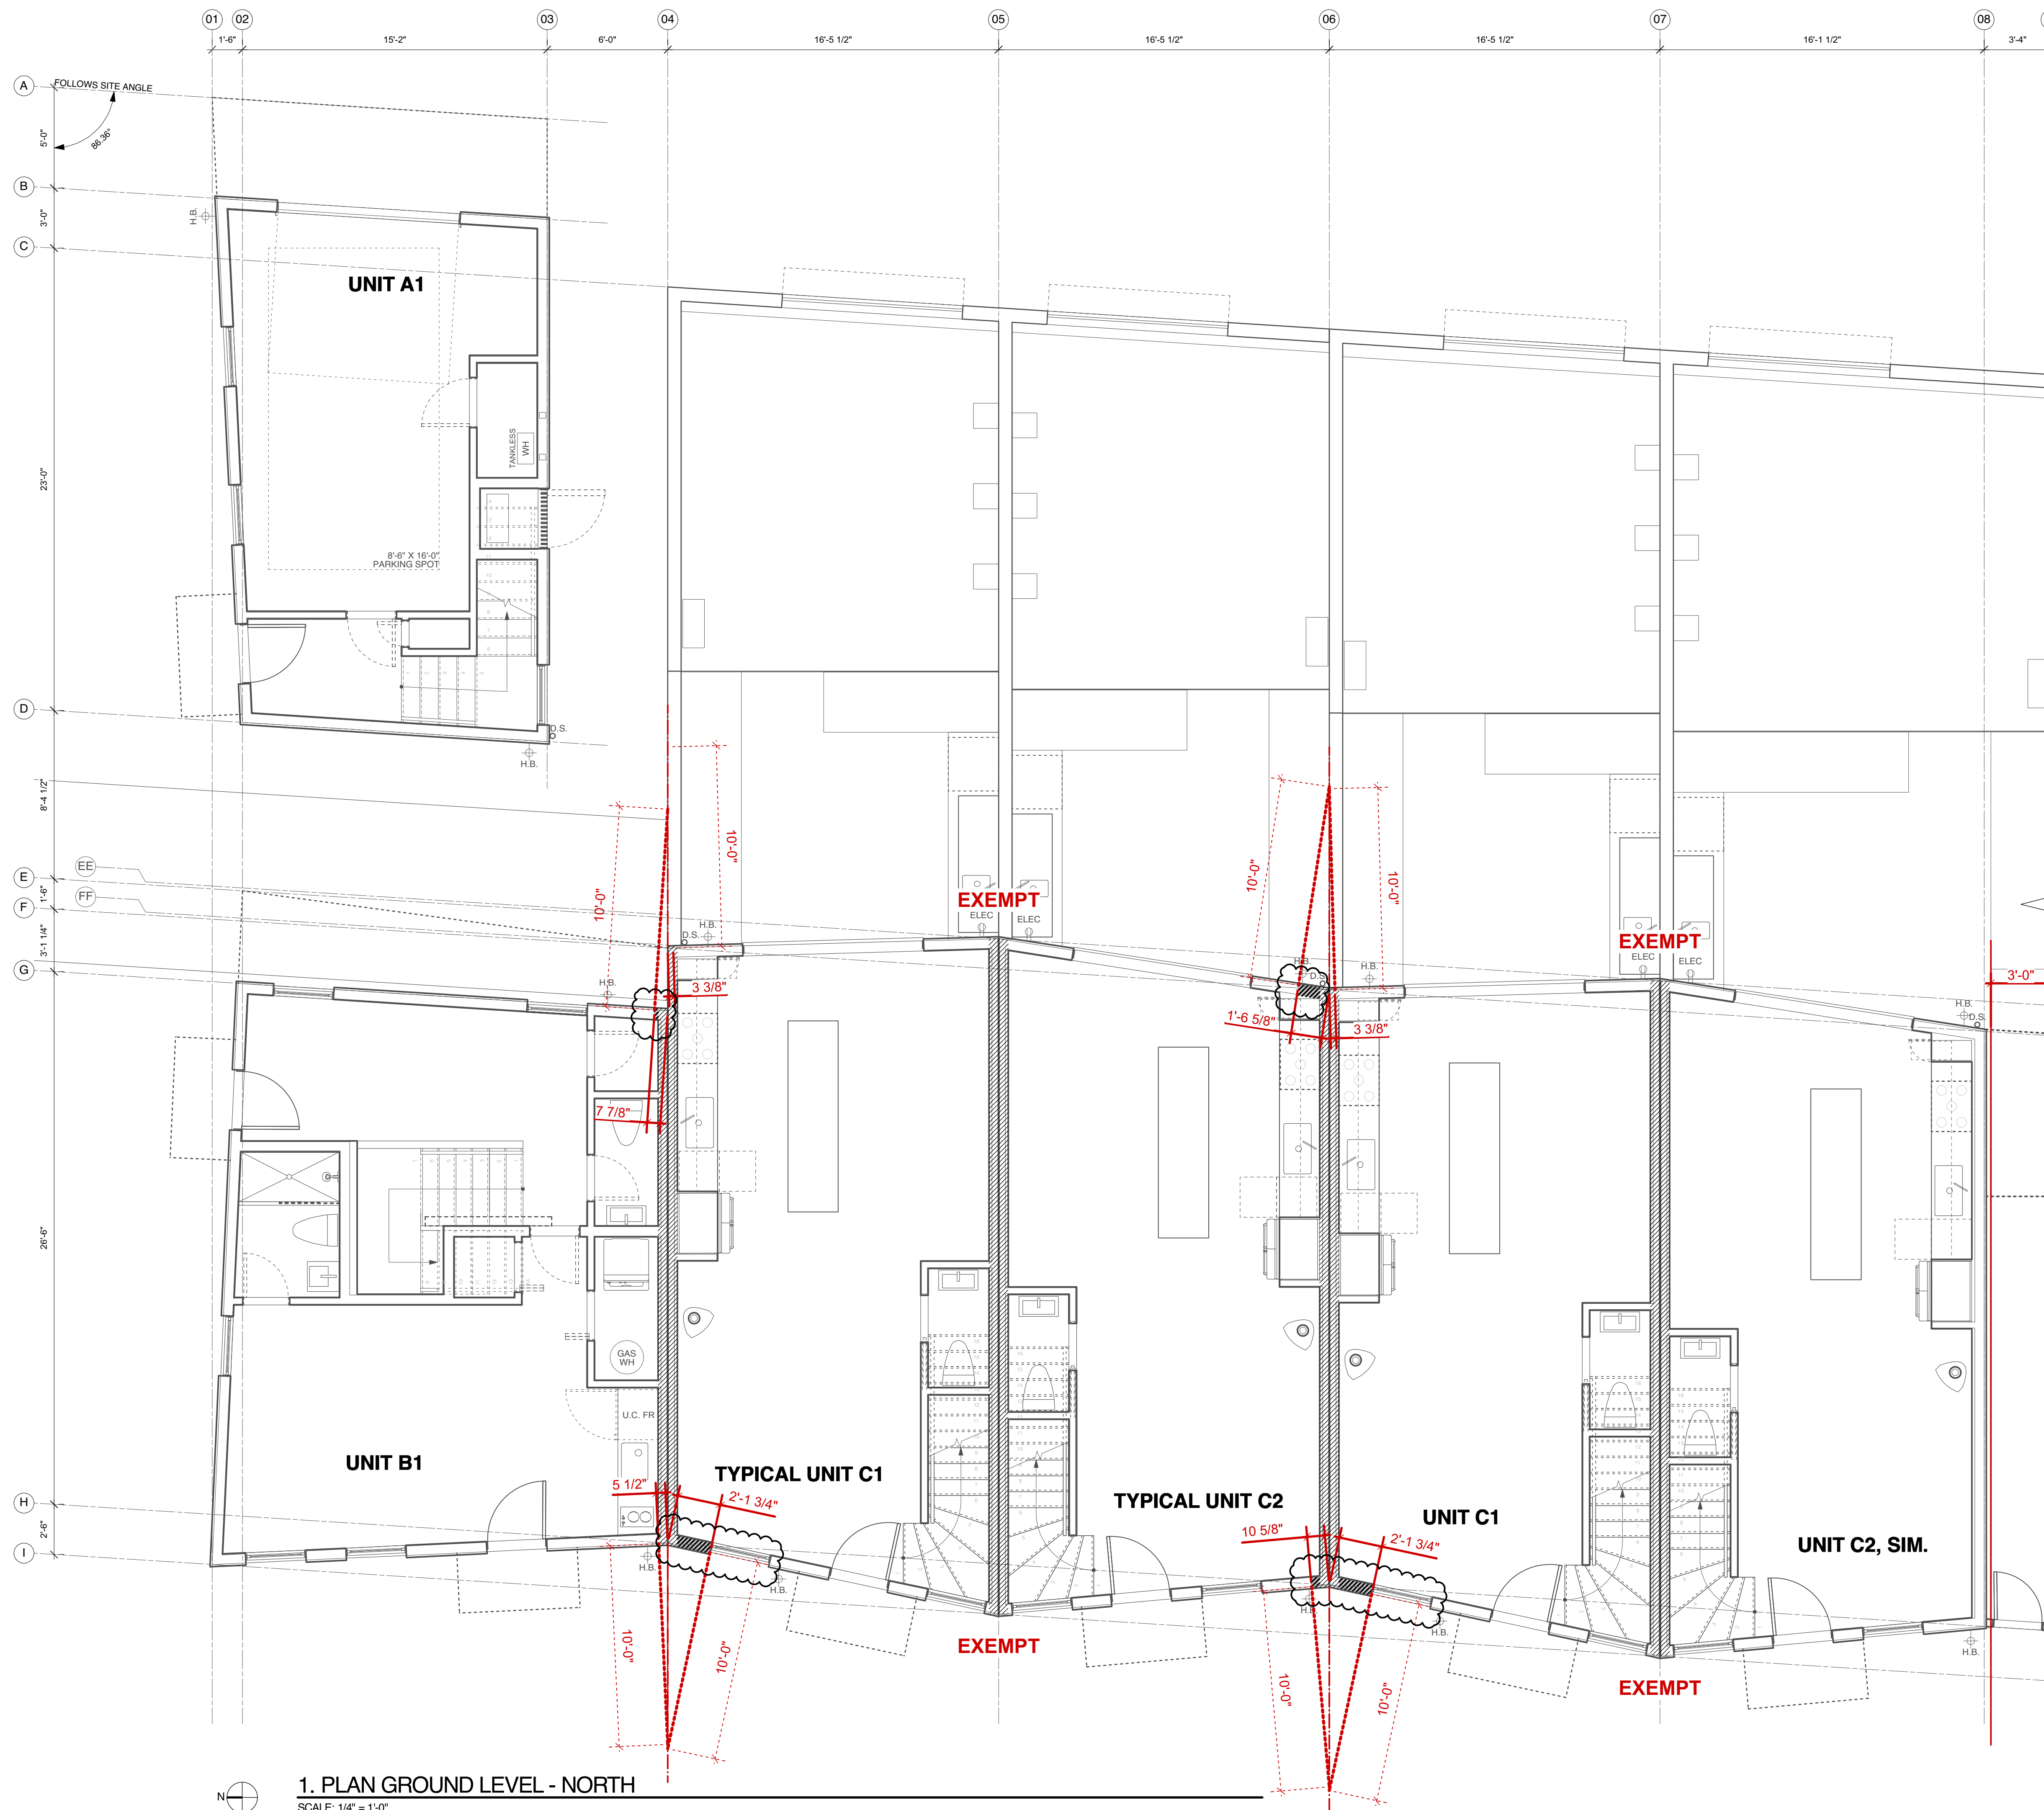

**GENERAL NOTES**

E3: 1-HR RATED WALL

1-HR EXTERIOR WALL

R-VALUE: 21 MIN

FIRE RATING: 1-HR  
UL DESIGN #U305  
STC: 56 (45 MIN REQ'D)



**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

**ORIGAMI**

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS  
NUMBER:      DATE:


**PERMIT SET**

DATE: 6.15.2017

PLAN GROUND  
LEVEL - NORTH

**A2.2**



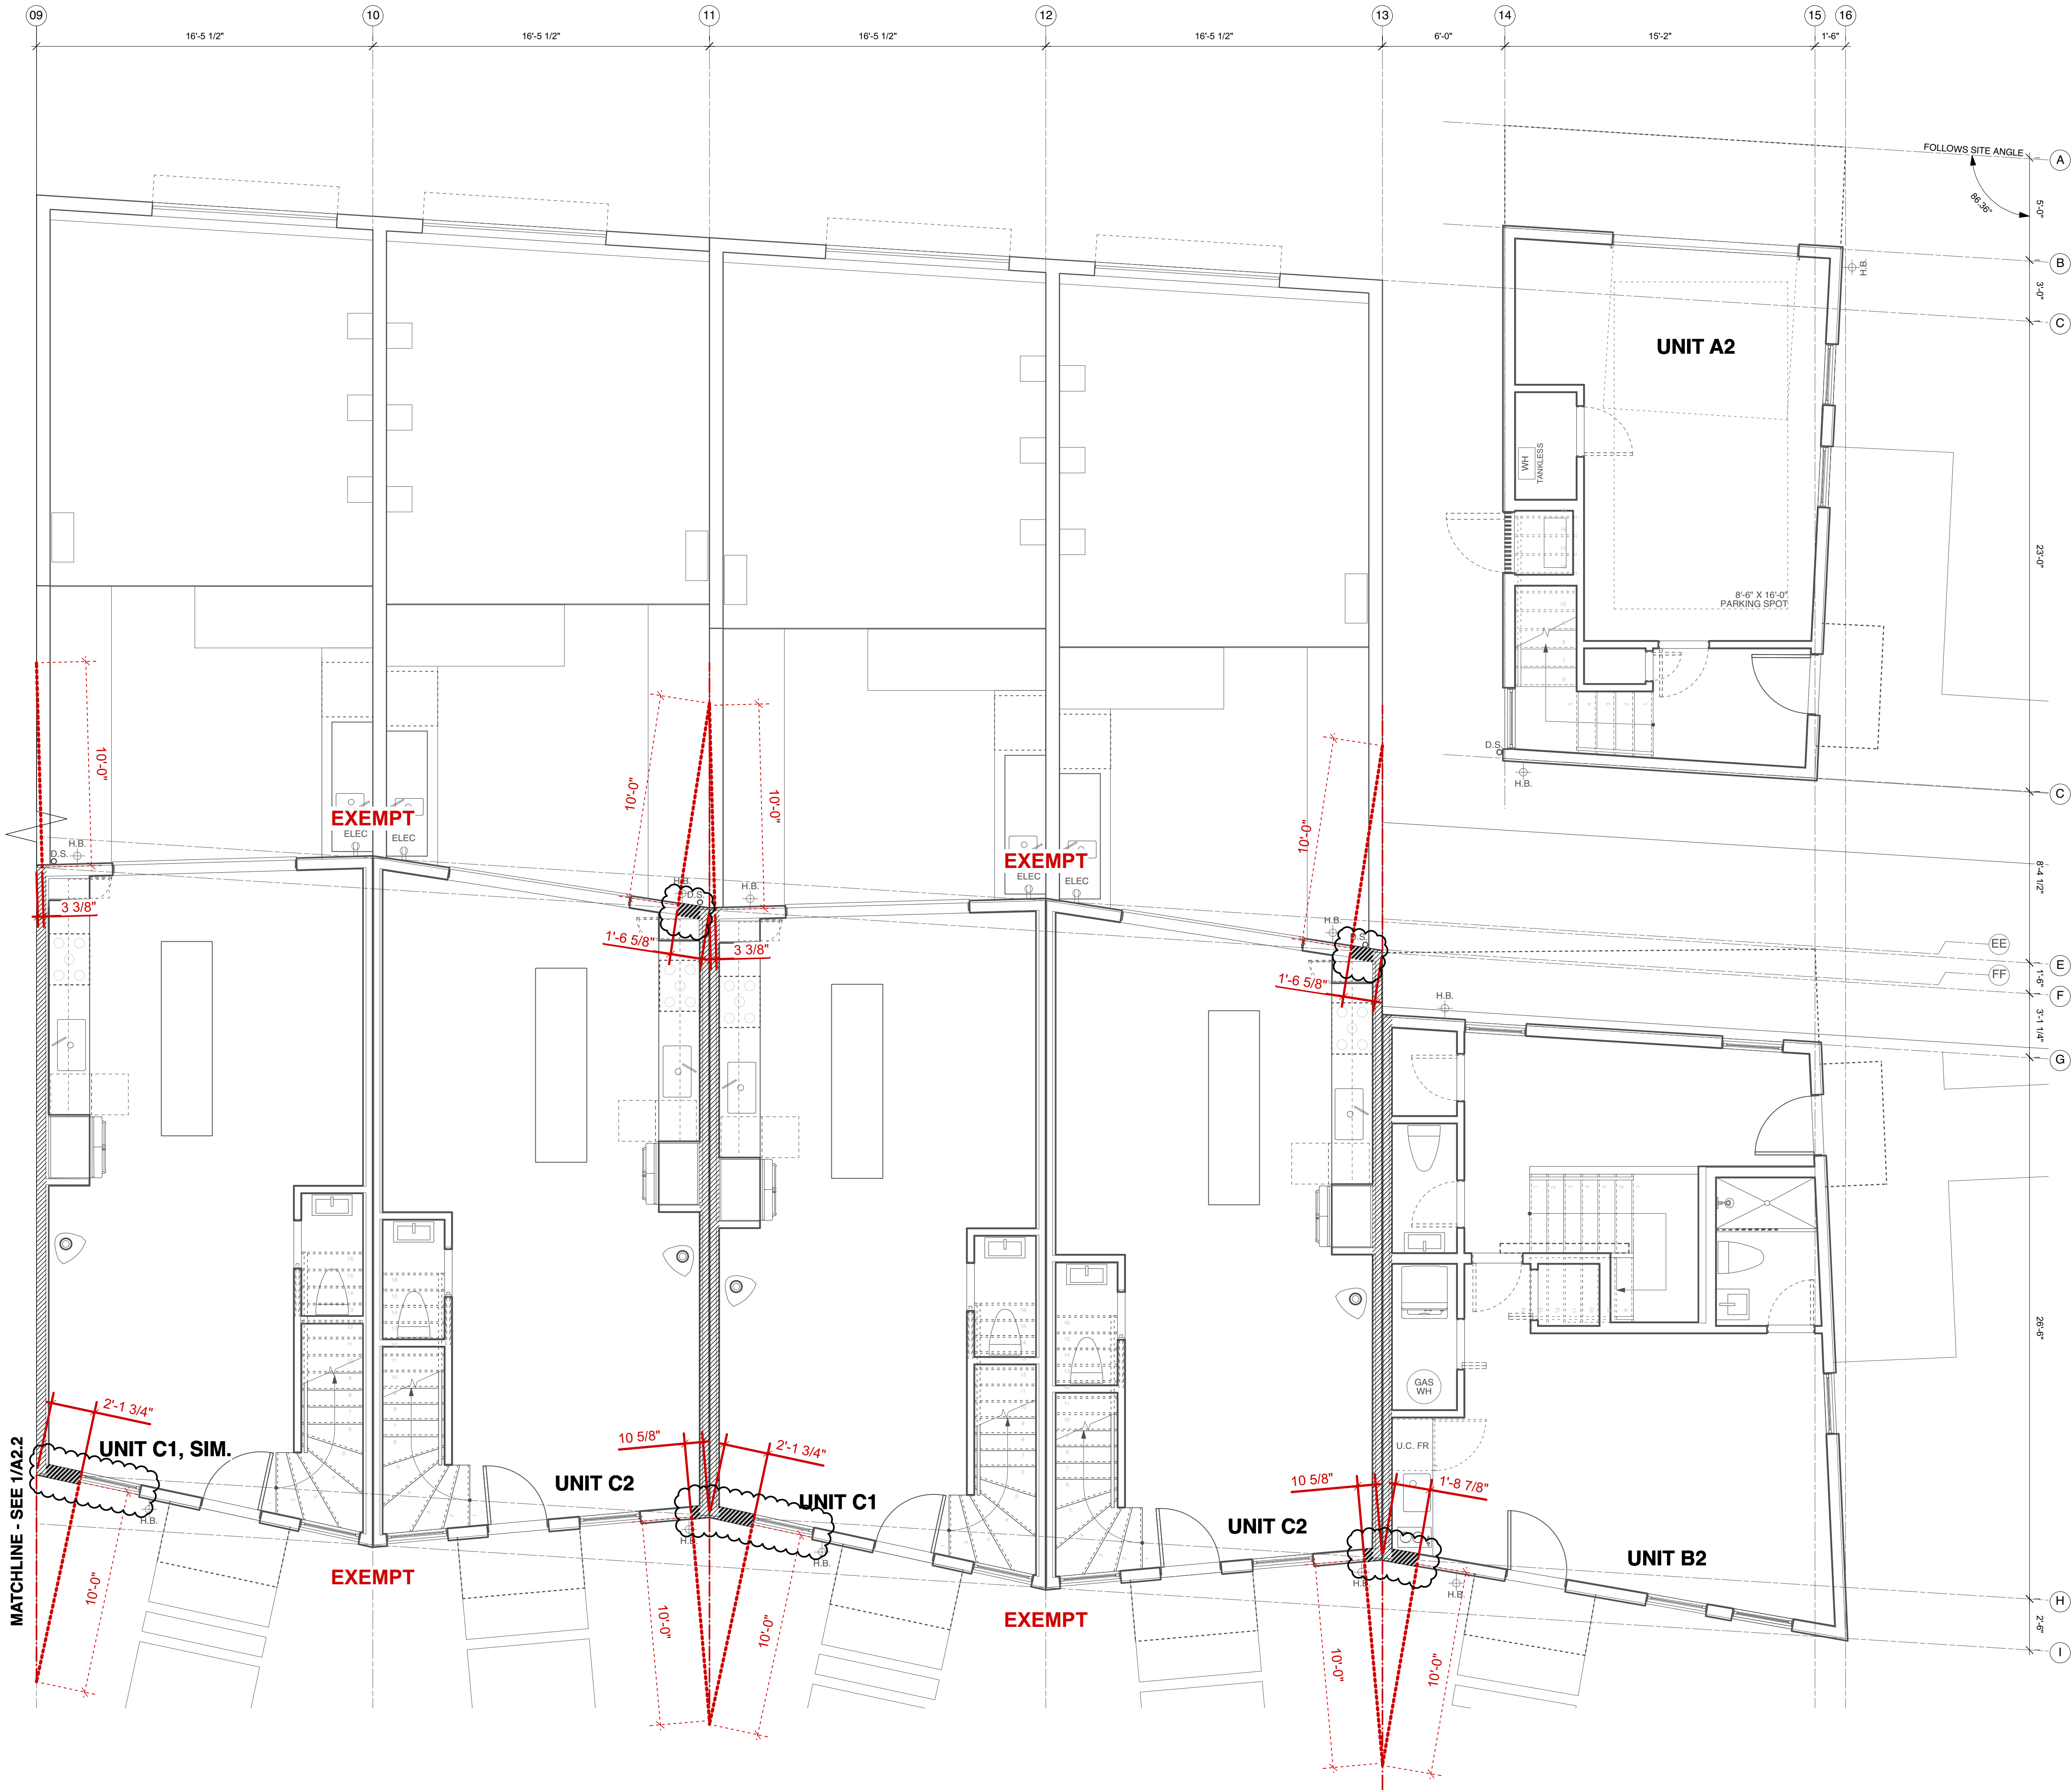

GENERAL NOTES

E3: 1-HR RATED WALL

GRID

5 1/2"

HARDI-BOARD SIDING  
W/ 6" EXPOSURE,  
SMOOTH FINISH  
OVER 1X3" PT  
BATTENS  
KRAFT FACED BATT  
R-21 INSULATION  
5/8" TYPE X GYPSUM BOARD  
PVA PRIMER VAPOR  
RETARDER  
TYVEK COMMERCIAL  
AIR BARRIER, ALL  
SEAMS TAPED  
5/8" DENS-GLASS  
"FIREGUARD  
SHEATHING"

1-HR EXTERIOR WALL

R-VALUE: 21 MIN

FIRE RATING: 1-HR  
UL DESIGN #1305  
STC: 56 (45 MIN  
REQD)



**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

ORIGAMI

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS	NUMBER:	DATE:


PERMIT SET

DATE: 6.15.2017

PLAN GROUND  
LEVEL - SOUTH

A2.3



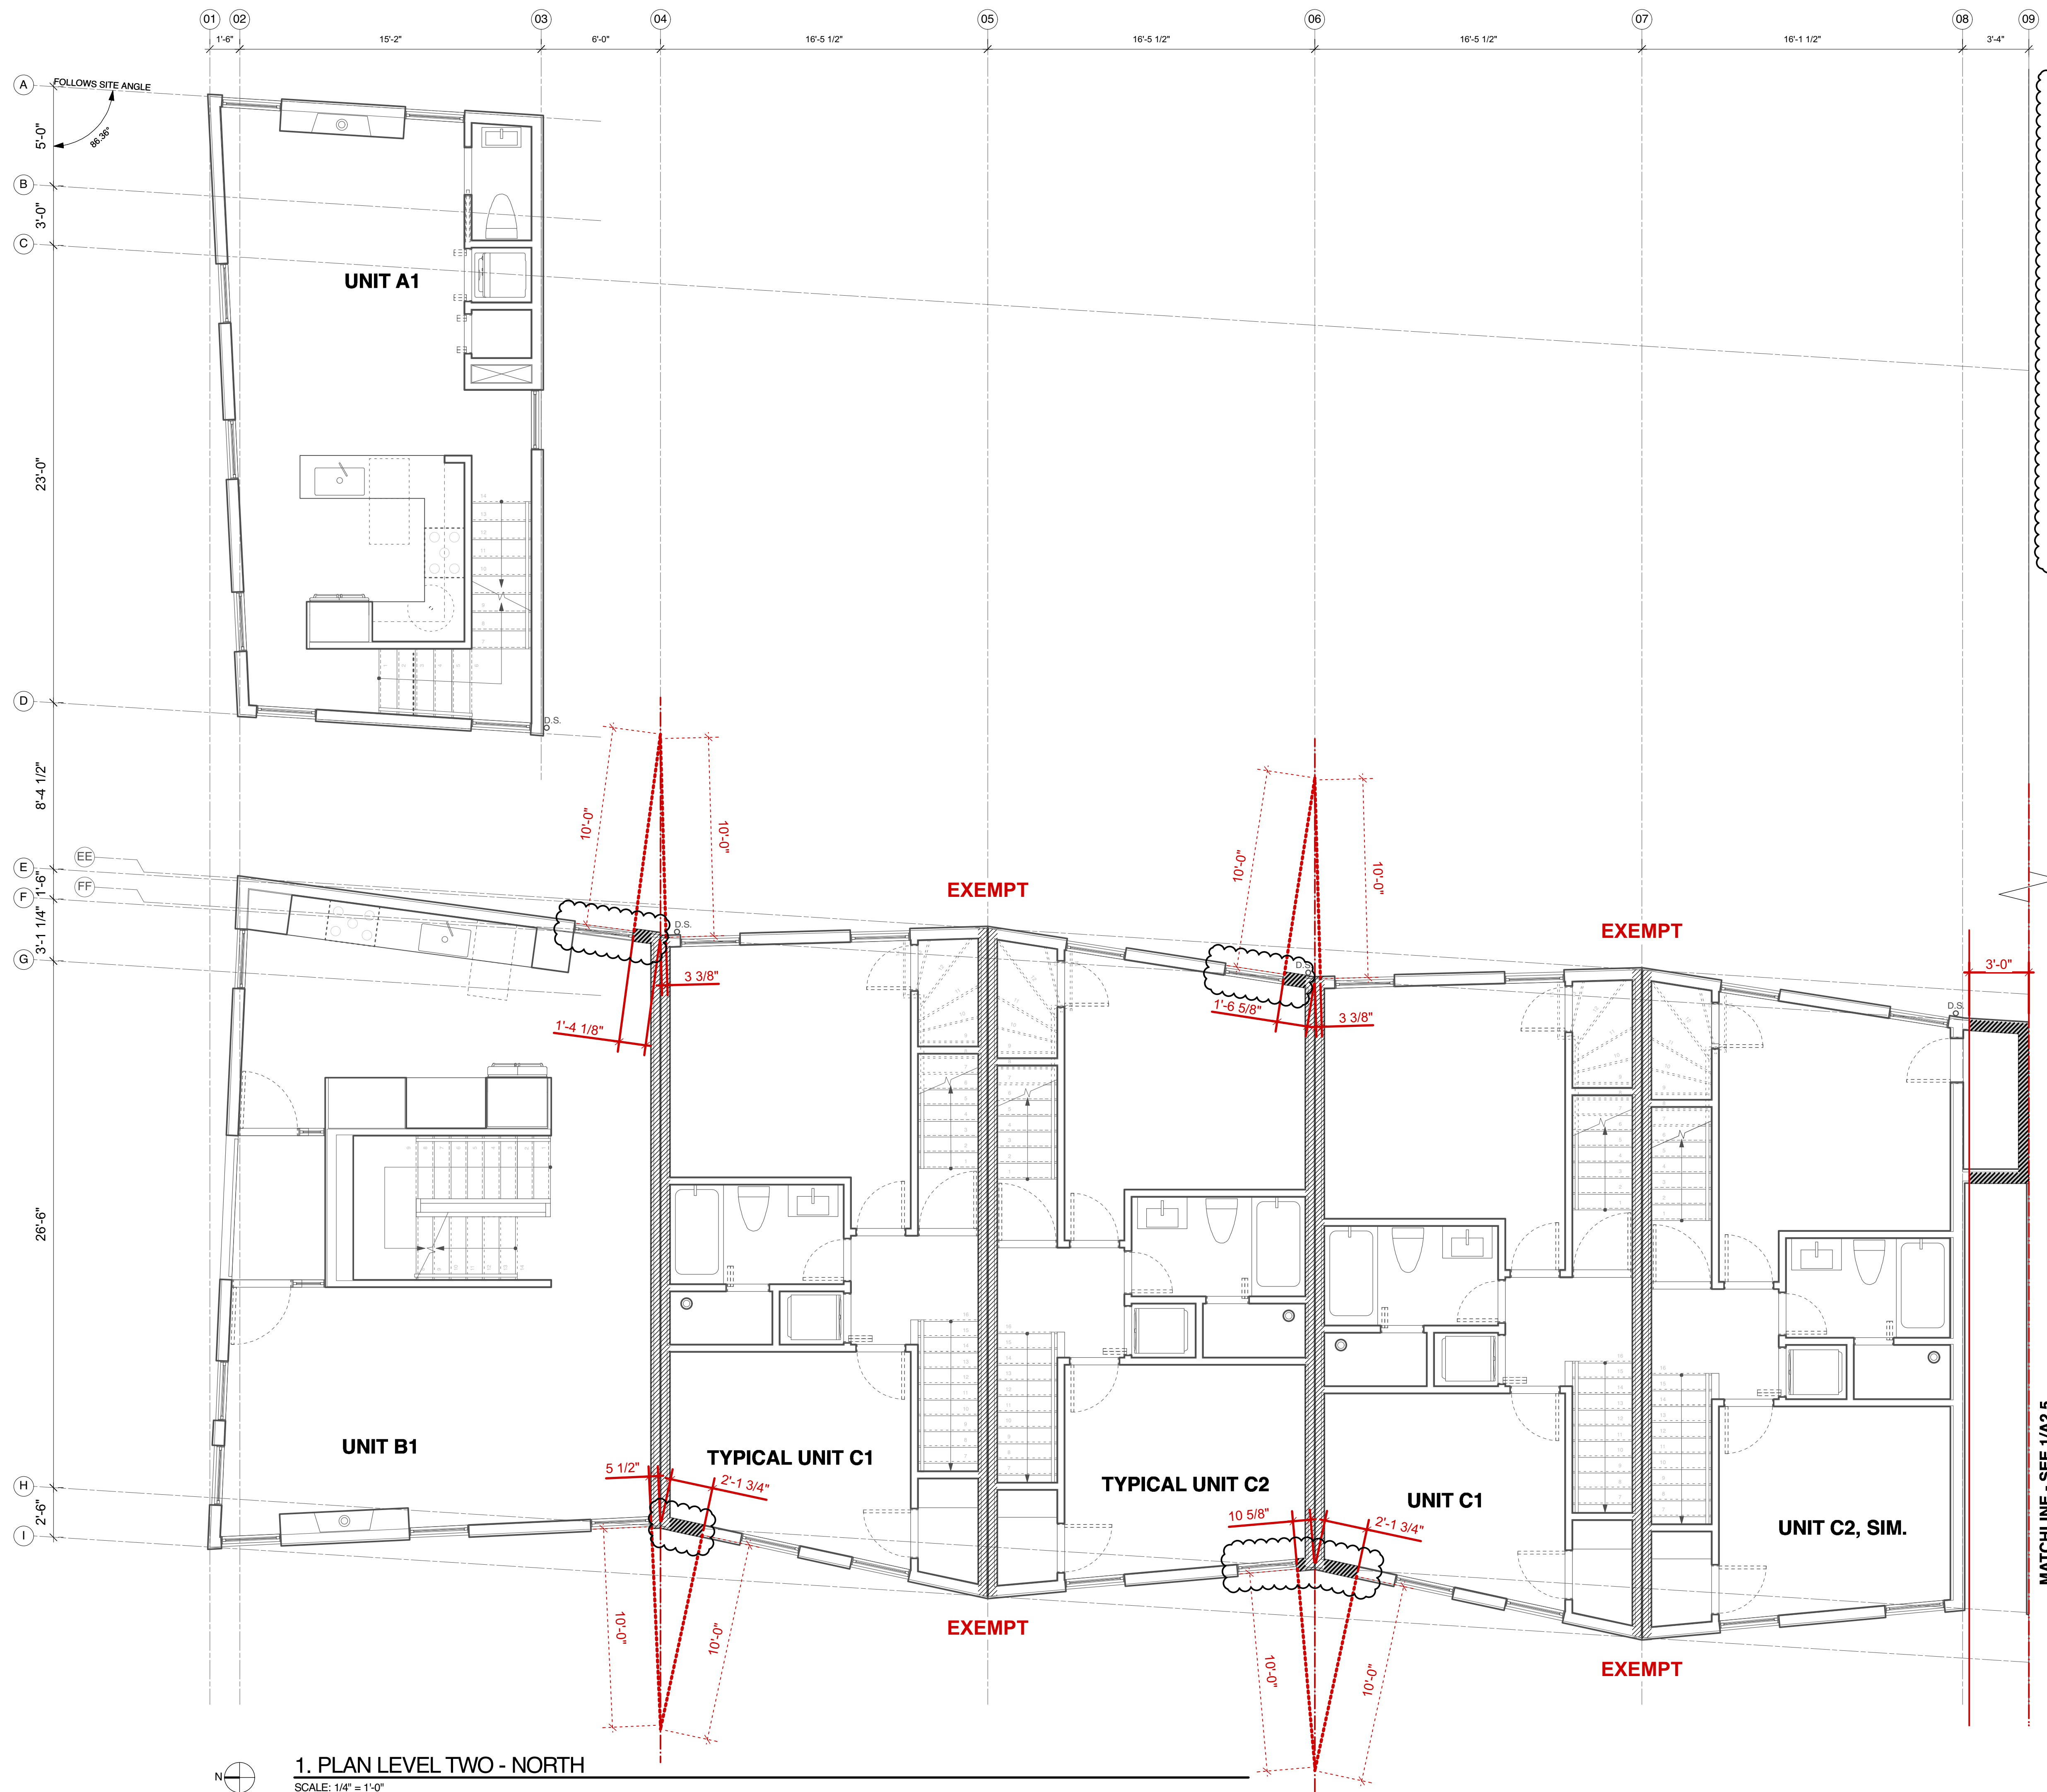

**GENERAL NOTES**

//// E3: 1-HR RATED WALL

5 1/2"

HARDI-BOARD SIDING  
W/ 6" EXPOSURE,  
SMOOTH FINISH  
OVER 1X3" PT  
BATTENS  
KRAFT FACED BATT  
R-21 INSULATION  
5/8" TYPE X GYPSUM BOARD  
PVA PRIMER VAPOR  
RETARDER  
TYVEK COMMERCIAL  
AIR BARRIER, ALL  
SEAMS TAPED  
5/8" DENS-GLASS  
"FIREGUARD  
SHEATHING"

**1-HR EXTERIOR WALL**  
R-VALUE: 21 MIN. FIRE RATING: 1-HR  
UL DESIGN #U305  
STC: 56 (45 MIN  
REQ'D)



**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

**ORIGAMI**

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS  
NUMBER: DATE:


**PERMIT SET**

DATE: 6.15.2017

PLAN LEVEL  
TWO - NORTH

**A2.4**

**1. PLAN LEVEL TWO - NORTH**  
SCALE: 1/4" = 1'-0"

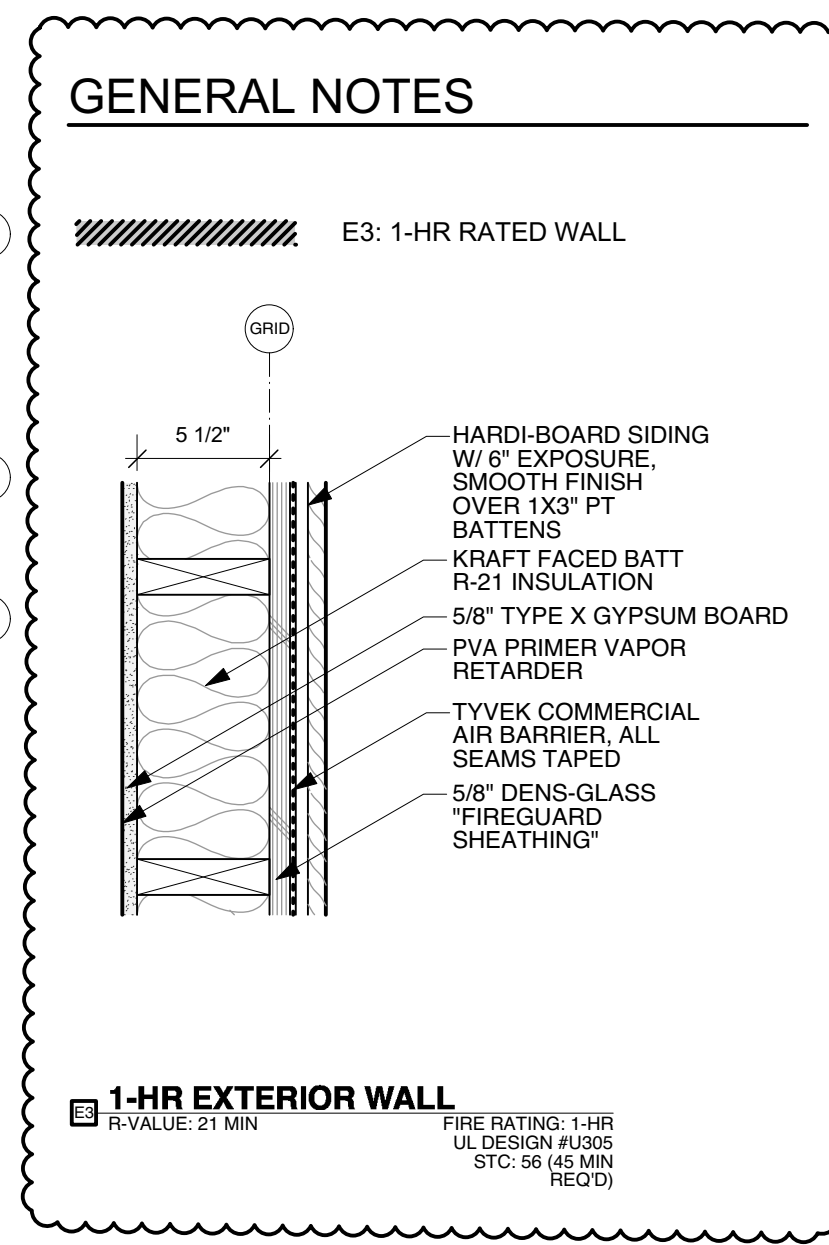

**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480

Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

## ORIGAMI

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS	
NUMBER:	DATE:


**PERMIT SET**

DATE: 6.15.2017

PLAN LEVEL  
TWO - SOUTH

## A2.5



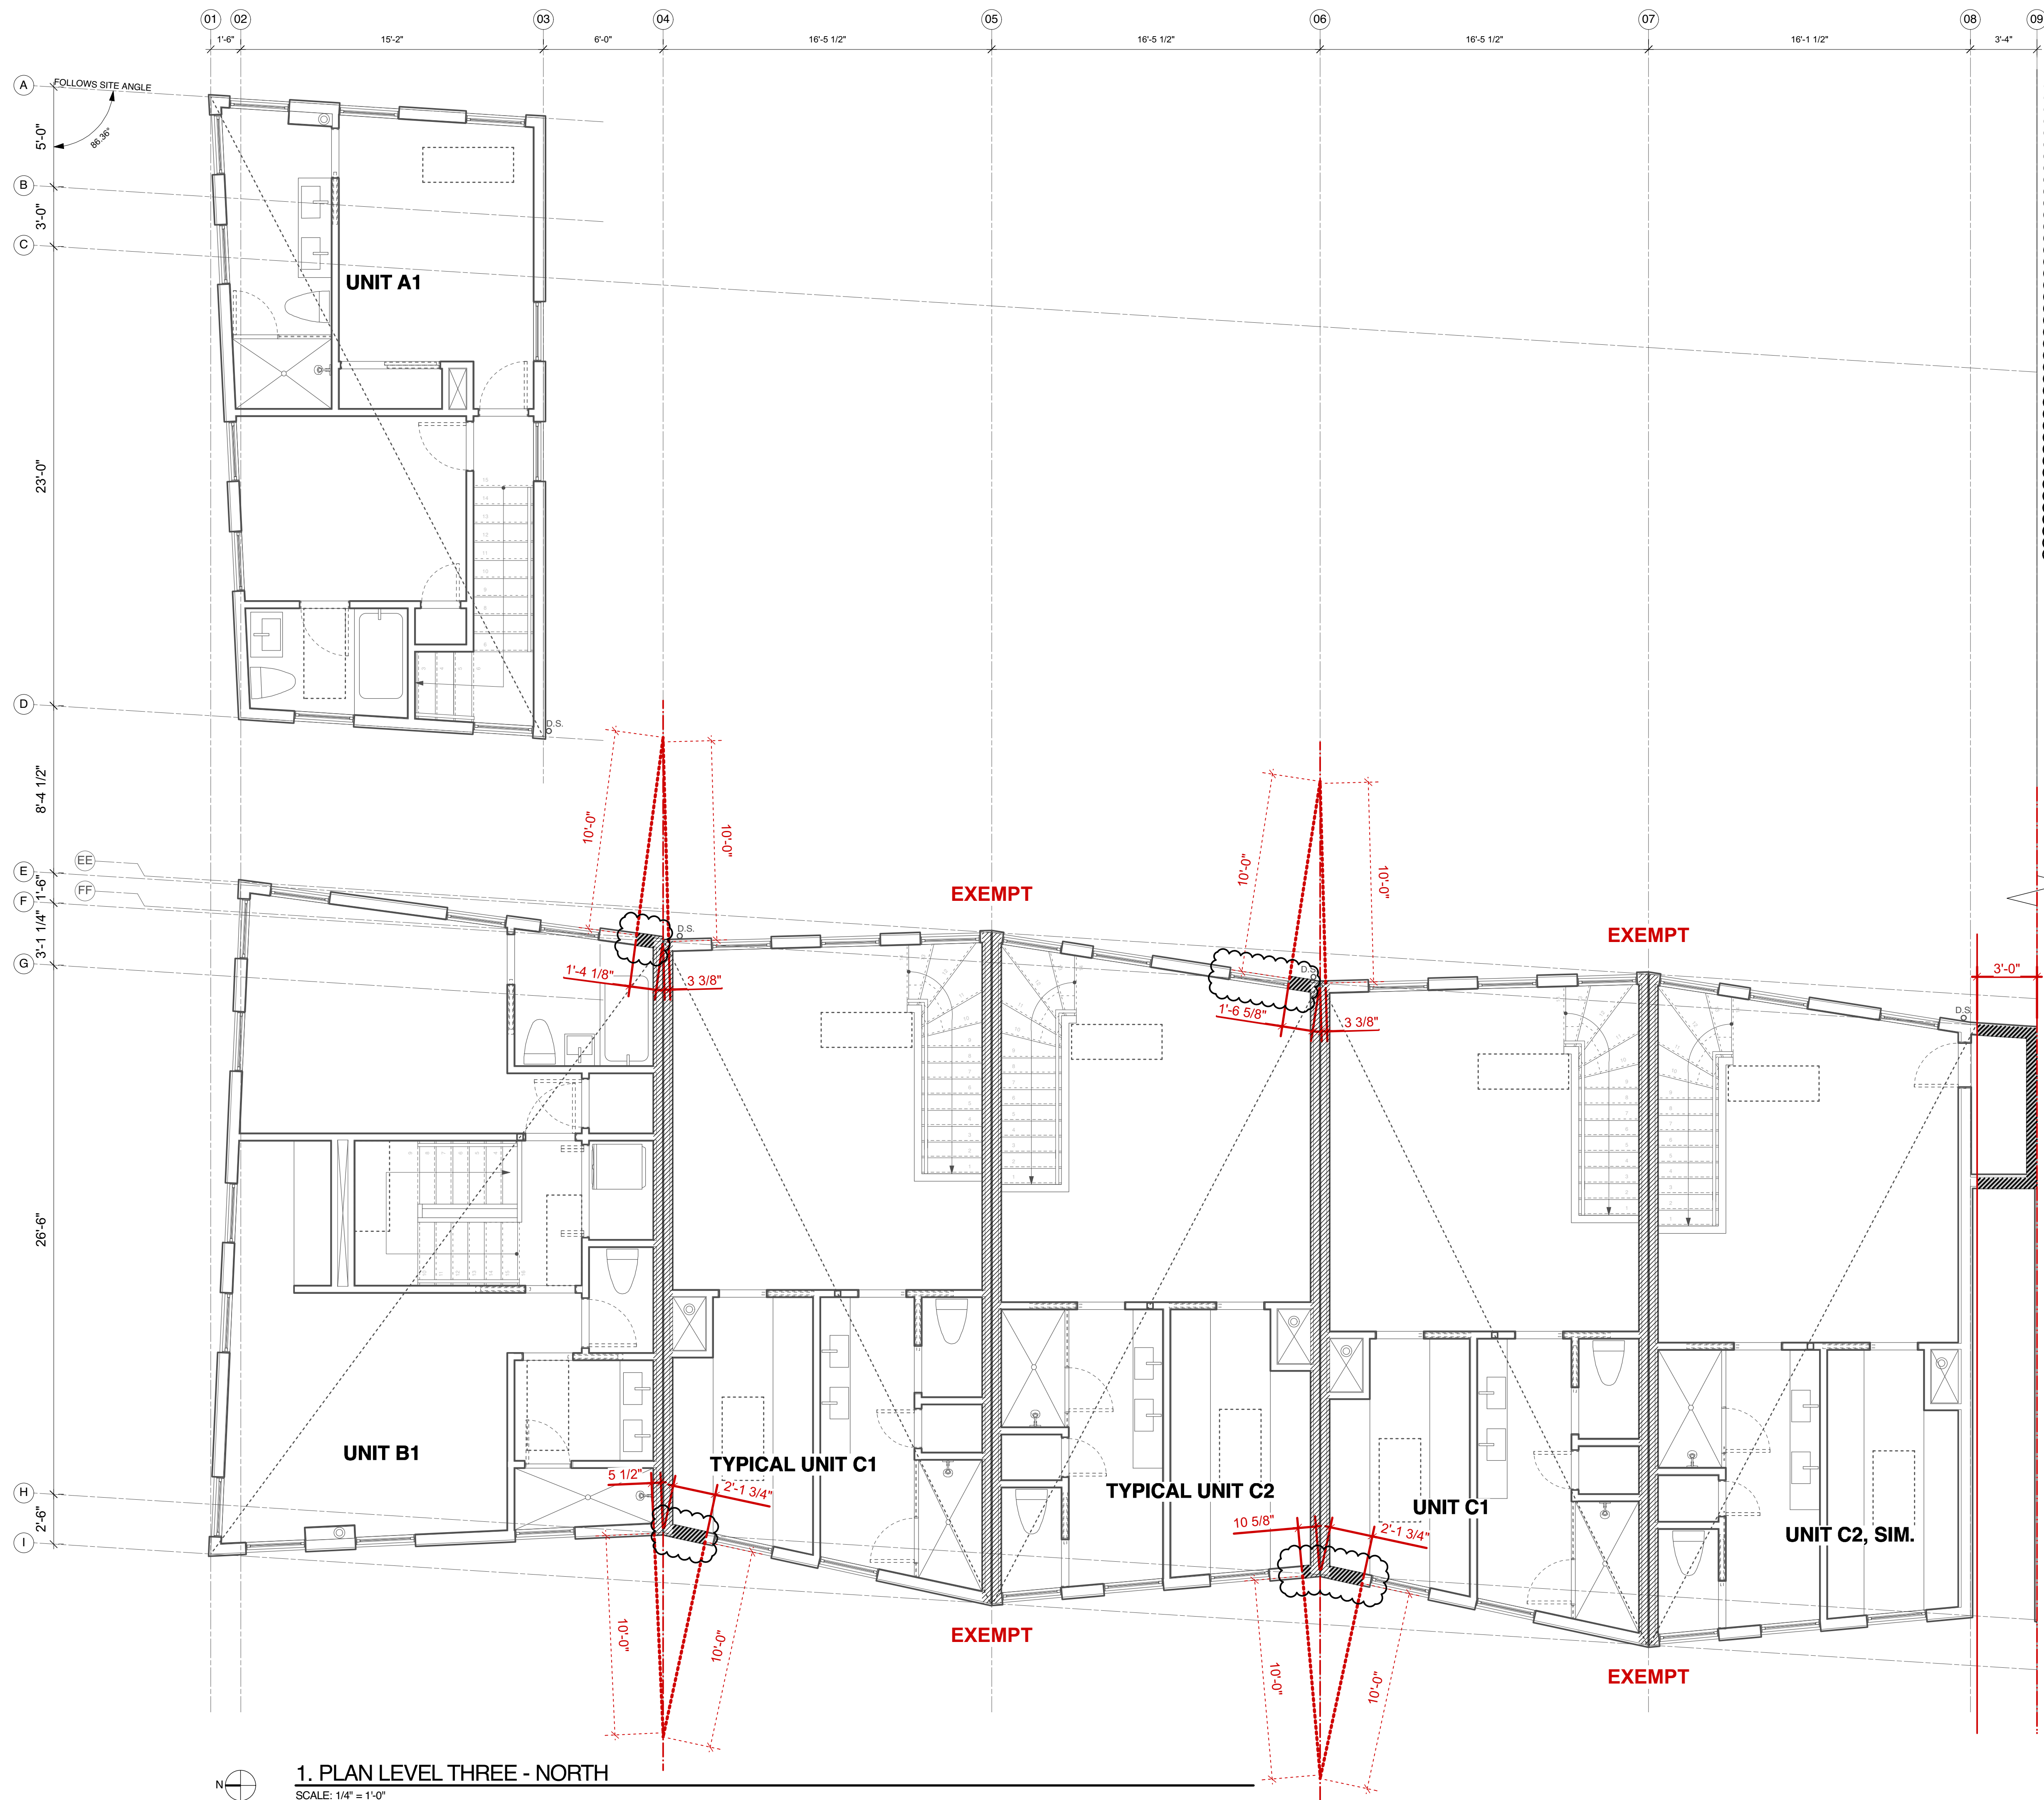

**GENERAL NOTES**

//// E3: 1-HR RATED WALL

5 1/2"

HARDI-BOARD SIDING  
W/ 6" EXPOSURE,  
SMOOTH FINISH  
OVER 1X3" PT  
BATTENS  
KRAFT FACED BATT  
R-21 INSULATION  
5/8" TYPE X GYPSUM BOARD  
PVA PRIMER VAPOR  
RETARDER  
TYVEK COMMERCIAL  
AIR BARRIER, ALL  
SEAMS TAPED  
5/8" DENS-GLASS  
"FIREGUARD  
SHEATHING"

**1-HR EXTERIOR WALL**  
R-VALUE: 21 MIN  
FIRE RATING: 1-HR  
UL DESIGN #U305  
STC: 56 (45 MIN  
REQ'D)



**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

**ORIGAMI**

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS  
NUMBER: DATE:


**PERMIT SET**

DATE: 6.15.2017

PLAN LEVEL  
THREE - NORTH

**A2.6**



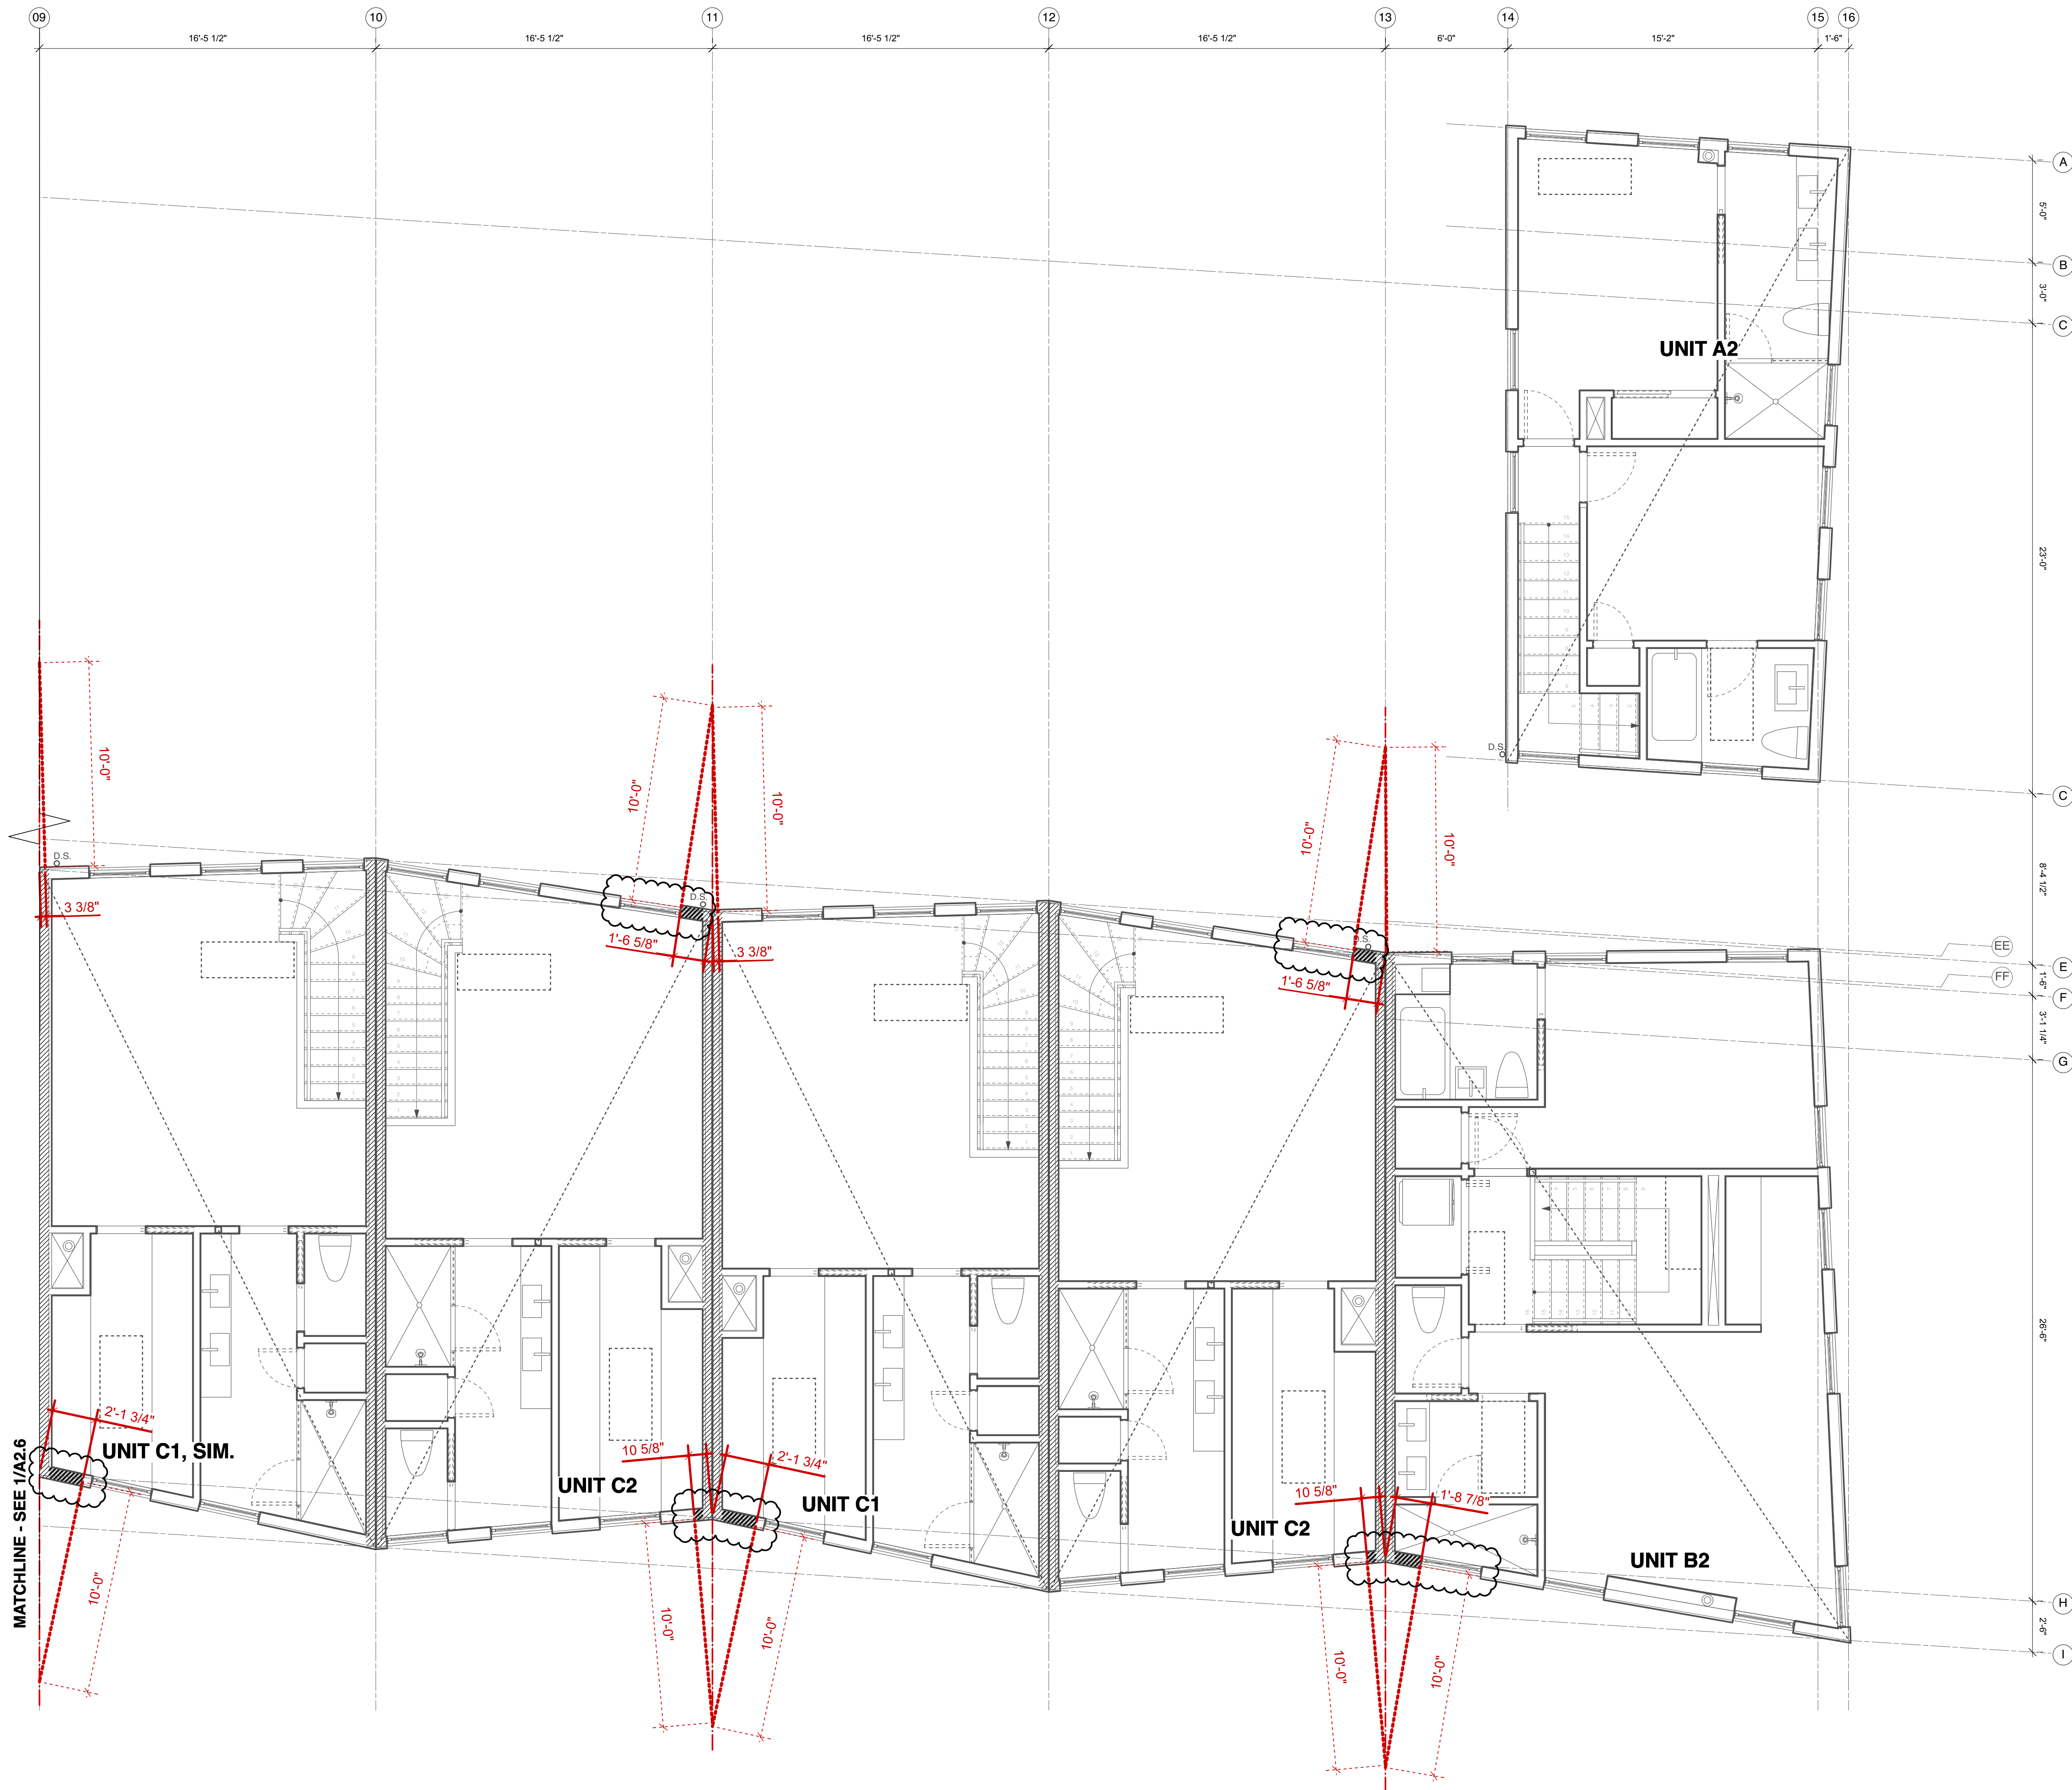

**GENERAL NOTES**

E3: 1-HR RATED WALL

5 1/2"

HARDI-BOARD SIDING  
W/ 6" EXPOSURE,  
SMOOTH FINISH  
OVER 1X3" PT  
BATTENS  
KRAFT FACED BATT  
R-21 INSULATION  
5/8" TYPE X GYPSUM BOARD  
PVA PRIMER VAPOR  
RETARDER  
TYVEK COMMERCIAL  
AIR BARRIER, ALL  
SEAMS TAPED  
5/8" DENS-GLASS  
"FIREGUARD  
SHEATHING"

**1-HR EXTERIOR WALL**  
R-VALUE: 21 MIN

FIRE RATING: 1-HR  
UL DESIGN #1305  
STC: 56 (60 MIN  
REQD)



**Waechter Architecture**  
3514 N. Vancouver Ave.  
Suite 300  
Portland, OR 97227  
503.894.9480  
Contact: Ben Waechter  
ben@benwaechter.com

WA PROJECT NO.  
2016 - 107

**ORIGAMI**

7120 N.  
VANCOUVER  
PORTLAND, OR  
97211

REVISIONS  
NUMBER:      DATE:

**PERMIT SET**

DATE: 6.15.2017

PLAN LEVEL  
THREE - SOUTH

**A2.7**



1. PLAN LEVEL THREE - SOUTH  
SCALE: 1/4" = 1'-0"