



**STANDARD OIL COMPANY OF CALIFORNIA,
WESTERN OPERATIONS, INC.**

8831 N.W. DOANE AVENUE PORTLAND OREGON 97208

MARKETING DEPARTMENT
OPERATIONS DIVISION
C. J. MALLISAN
SUPERINTENDENT
WILLBROS DISTRIBUTING PLANT

December 13, 1967

Mr. R. L. Cairney
Terminal Superintendent
Union Oil Company of California
P. O. Box 76
Portland, Oregon 97207

Dear Mr. Cairney:

The Standard Oil Company of California has no objection to the Union Oil Company of California erecting proposed tanks #4258 and #4266 for the storage of refined petroleum products.

We understand by your Plot Plan entitled, "Asphalt Plant Project #6701", these tanks will be 10'9" x 30', of 475 barrel capacity, and will be located along our South property line, a distance of at least one-half the diameter of the tank from our property line.

Very truly yours,

DJM:ms

12-14-67
letter handed to Ron McLotho.
at his office this AM
Ken

DEC 13 1967 HKP

DEC 13 1967 LMC

ACCEPTANCE

Portland, Oregon, December 22, 1967

RAY SMITH
Auditor of the City of Portland,
Room 202, City Hall
Portland, Oregon 97204

Dear Sir:


This is to advise the City of Portland, Oregon, that I hereby accept the terms and provisions of Ordinance No. 125936, passed by the Council December 21, 1967 granting a revocable permit to Union Oil Company of California to construct a flammable liquids storage tank at certain conditions, and declaring an emergency.

and in consideration of the benefits to be received thereunder by me I hereby agree to abide by and perform each and all of the terms and provisions thereof applicable to me.

Very truly yours,

UNION OIL COMPANY OF CALIFORNIA

By

[CORPORATE
SEAL]

ASSISTANT SECRETARY

5528 N. W. Duane Ave. Portland, Oregon 97208
Address

Approved as to form:


City Attorney

*When an acceptance is required from a firm or corporation the Acceptance must be signed by an officer of the firm or corporation stating his or her official title, and corporations must affix the corporate seal.



**STANDARD OIL COMPANY OF CALIFORNIA,
WESTERN OPERATIONS, INC.**

5531 N.W. DOANE AVENUE PORTLAND OREGON 97208

MARKETING DEPARTMENT
OPERATIONS DIVISION
D. J. MACLEAN
SUPERINTENDENT
WILLBRIDGE DISTRIBUTING PLANT

December 13, 1967

Mr. R. L. Cairney
Terminal Superintendent
Union Oil Company of California
P. O. Box 76
Portland, Oregon 97207

Dear Mr. Cairney:

The Standard Oil Company of California has no objection to the Union Oil Company of California erecting proposed tanks #4258 and #4266 for the storage of refined petroleum products.


We understand by your Plot Plan entitled, "Asphalt Plant Project #6701", these tanks will be 10'9" x 30', of 475 barrel capacity, and will be located along our South property line, a distance of at least one-half the diameter of the tank from our property line.

Very truly yours,


DJM:ms

REFERENCE DRAWINGS


BM.

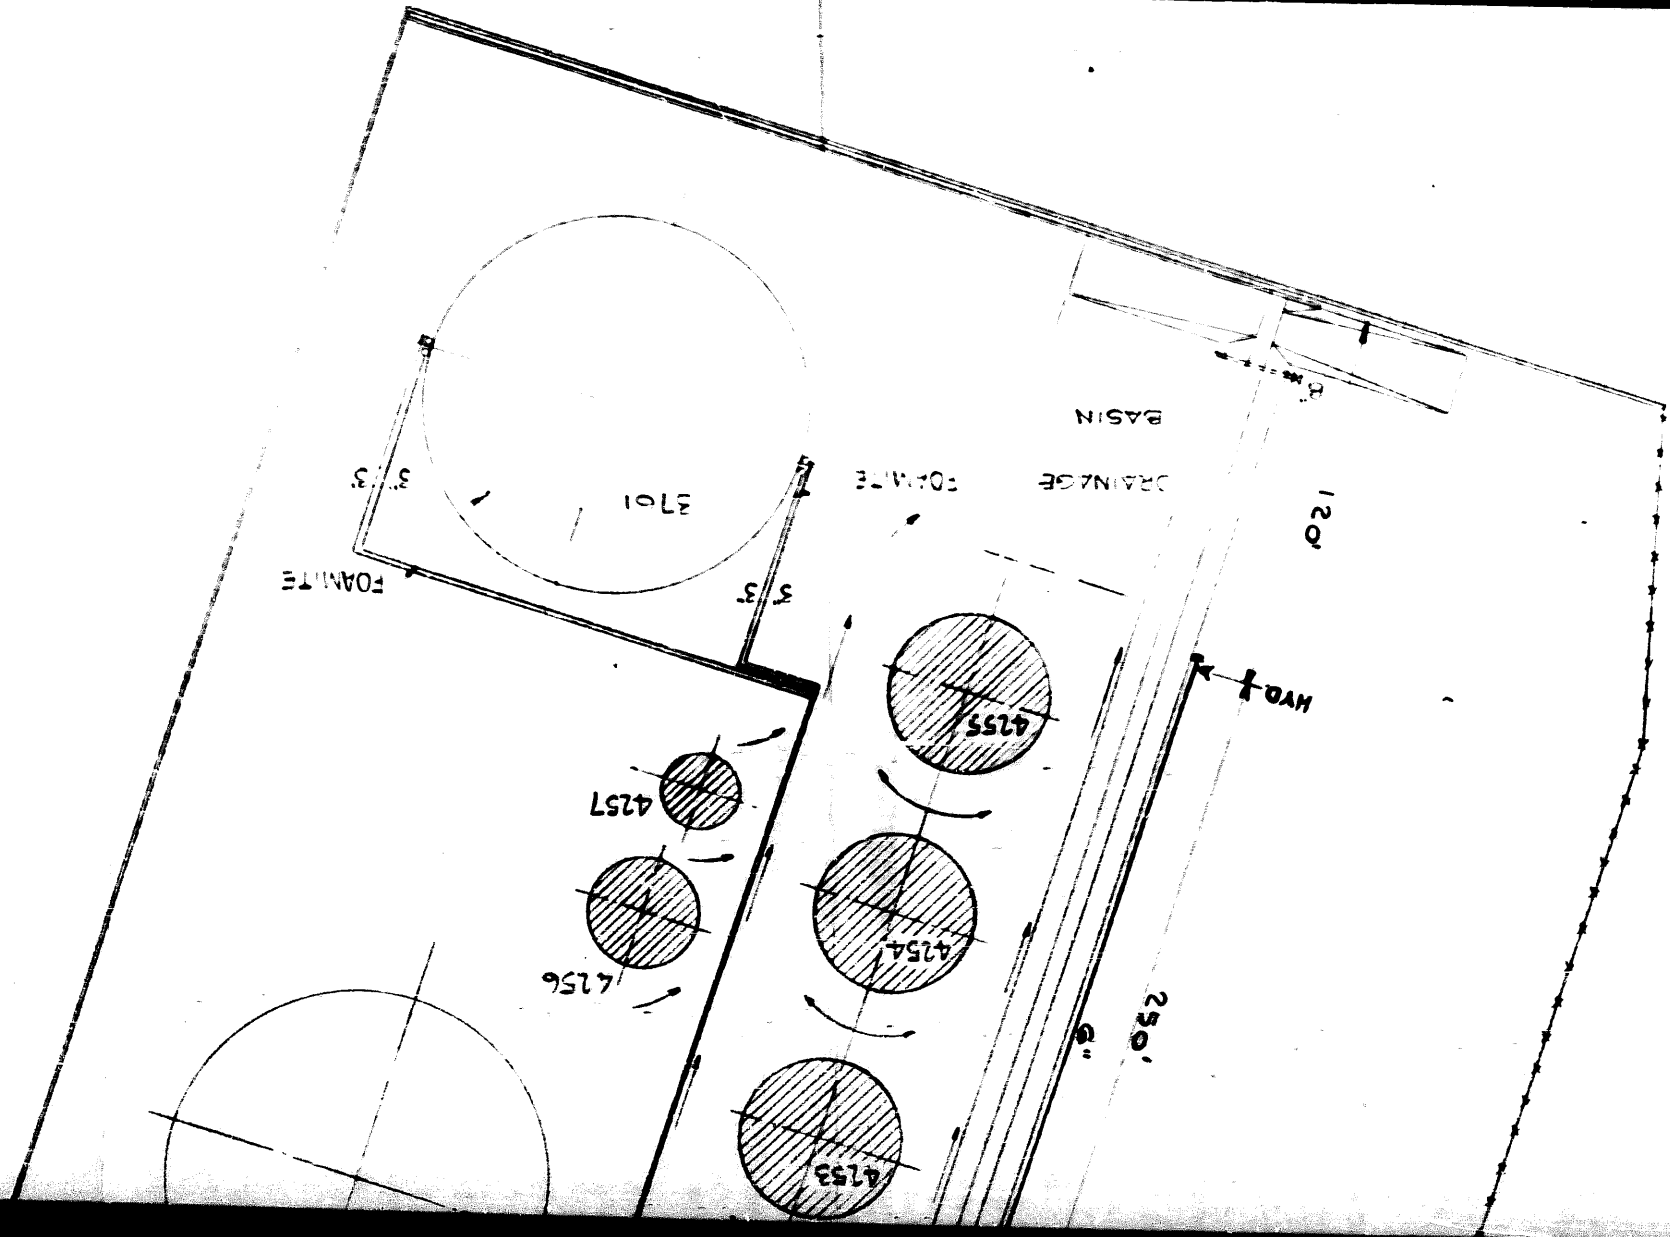

SCALE - 1"=50'0"

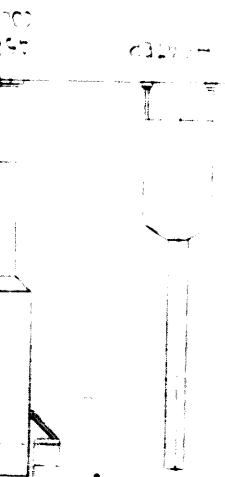

EXCESS IMPOUNDING CAPACITY 165.6% 886 4.962

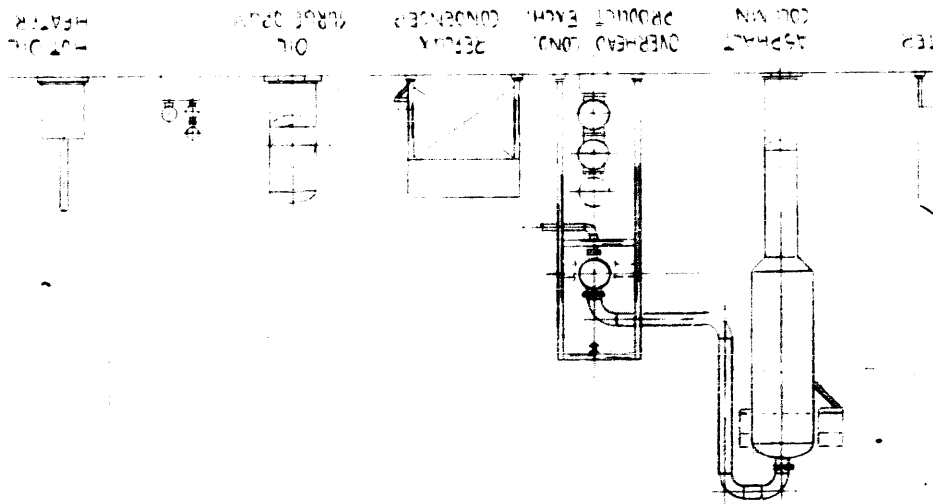

SECTION A-A
SCALE 1/8" = 1'-0"

J. J. J.

REV. NO.	DATE	REVISIONS	APPROVED FOR CONSTRUCTION	DRAWN BY	CHECKED BY	TRACED BY	TRACED CND	APP'D	APP'D	SCALE	DATE
1	7/6/67	TANK FABRI-4 DESIGN & DIMENSIONS NOTES	23812	6-23-67	23812	6-23-67	23812	6-23-67	23812	6-23-67	6-22-67
2	11/21/67	TANK FABRI-3 ADDED TANK #4266, CHANGED TO SIZE & LOCATION OF TANK #4258									


ASPHALT PLANT PORTLAND MARKETING TERMINAL PROJECT NO 6701		CONTRACTOR JACOBS ENGINEERING CO. PASADENA CALIFORNIA		CONTR. JOB NO. 423	
PLOT PLAN		UNION OIL COMPANY OF CALIFORNIA LOS ANGELES, CAL.		PROJECT DRAWING NO. 6701-Y-5-2	

NOTE: NEW TANKS DESIGNATED THUS



TANK NO	DIA.	HT.	CAP./BALS	ROOF	COE ROOF	FLOATING ROOF	COE ROOF	FLOATING ROOF
4258	50'-0"	32'-0"	10,000					
4253	"	"	"					
4254	"	"	"					
4255	"	"	"					
4256	35'-0"	32'-0"	5,000					
4259	"	"	"					
4257	25'-0"	16'-0"	1,000					
4258	10'-9"	30'-0"	475					
4241	"	"	"					
4242	"	"	"					
4243	"	"	"					
4244	"	"	"					
4245	"	"	"					
4266	"	"	"					

N W DOANE STR

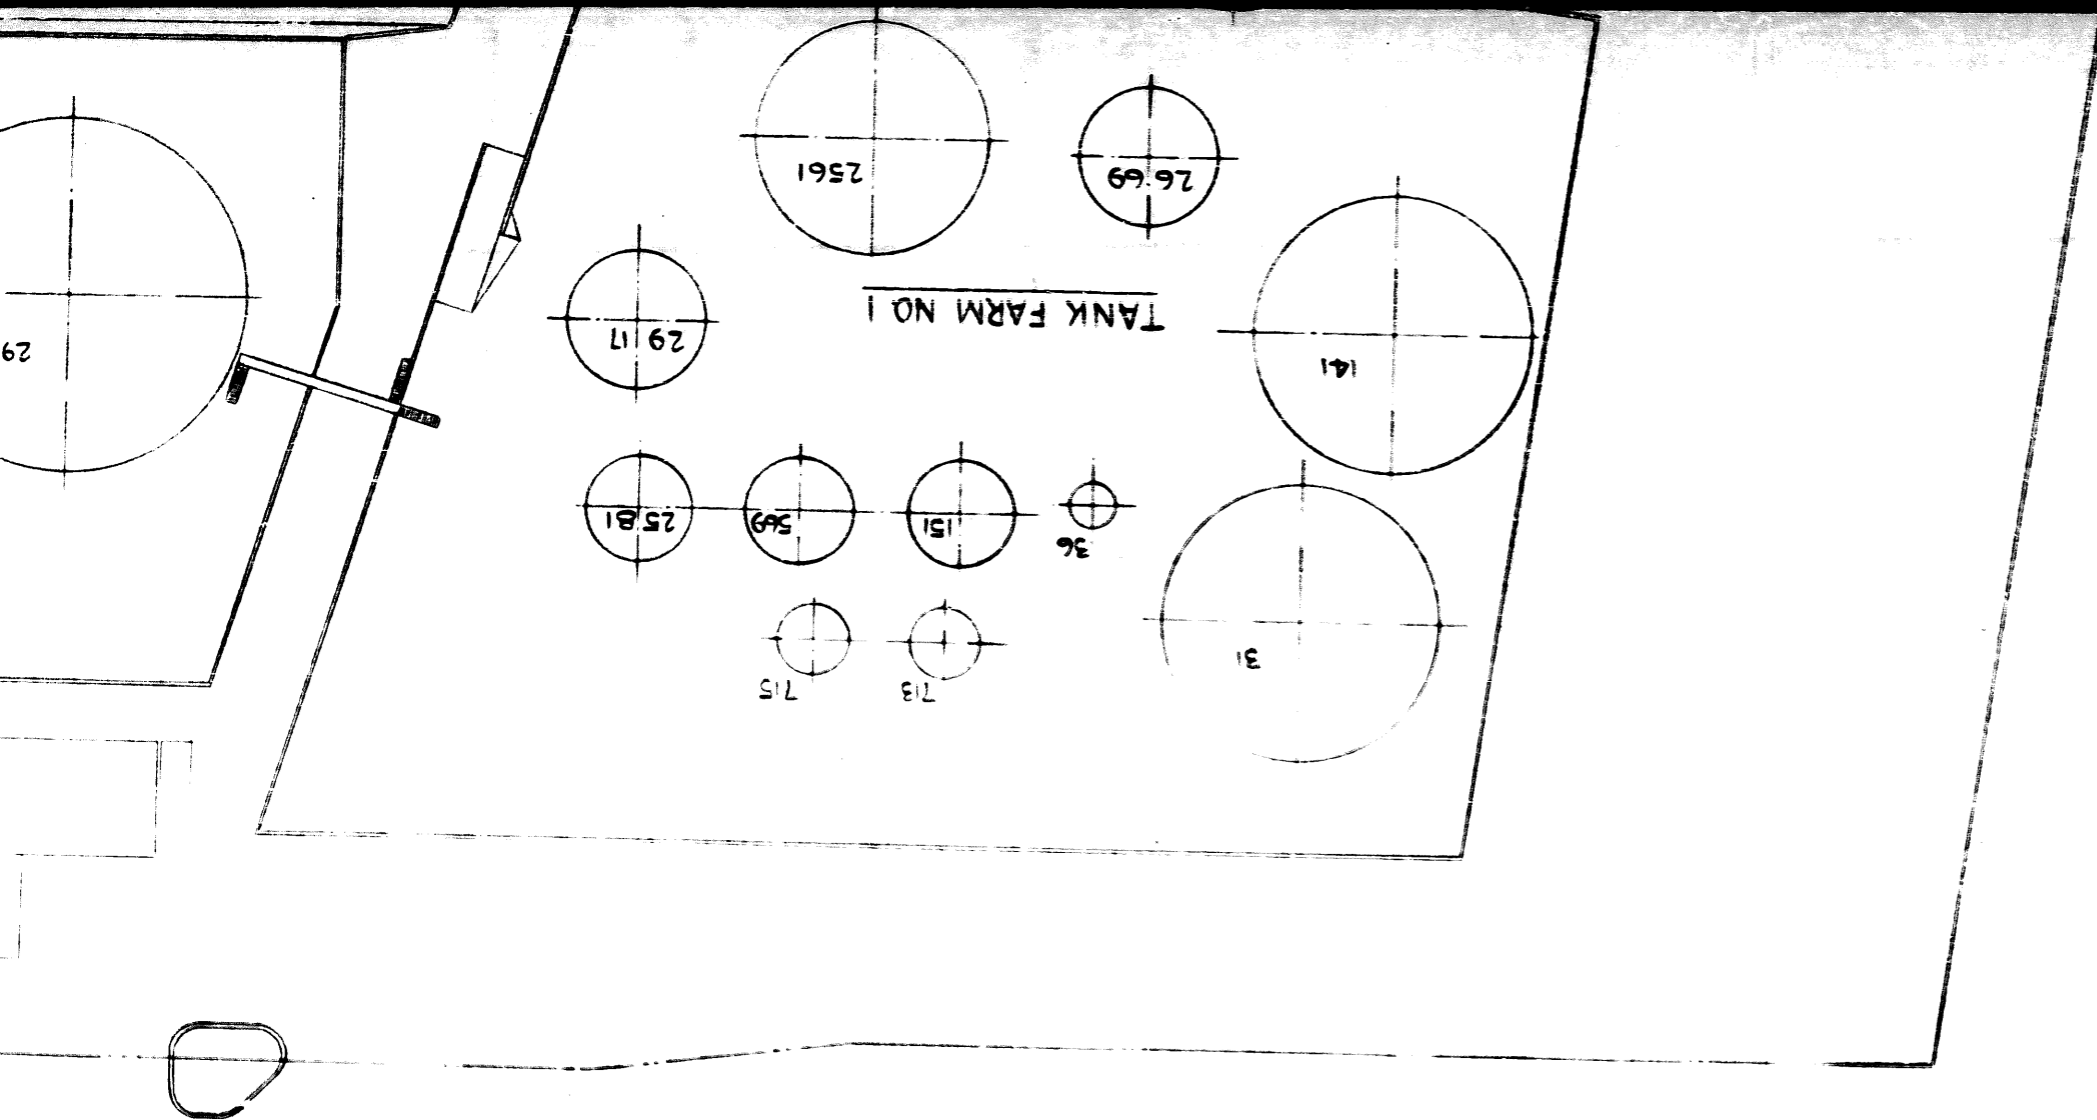

4256
4254
25

STREET

GARAGE

NOM. EL. + 4.50
GRADE + 4.50
4272

4259

3410

3411

2982

2983

3412

3413

TANK FARM NO 2

2915

2916

3409

3408

3407

N. FRONT STREET

ORDINANCE NO. 125936

An Ordinance granting a revocable permit to Union Oil Company of California to construct a flammable liquids storage tank at their property at 5528 N.W. Doane Avenue, subject to certain conditions, and declaring an emergency.

The City of Portland ordains:

Section 1. The Council finds that on or about November 27, 1967, Union Oil Company of California, by J.R. Hannaman, Project Manager, C/o 5528 N.W. Doane Avenue, Portland, Oregon 97208, has requested permission to construct an additional flammable liquids storage tank at its Terminal at 5528 N.W. Doane Avenue and to change the location of tank No. 4258 and to increase its capacity from 325 to 480 barrels; that inspection has been made of the premises by the Bureau of Buildings and the Building Inspections Director has recommended that the permit be granted subject to the conditions recommended by the Fire Marshal, as contained in said Fire Marshal's report dated December 5, 1967; that said report shows that the proposed construction conforms generally to requirements of Article 14 of the Fire Code and Volume 1 of the National Fire Codes, with the exception of Section 14-1410 (b) of the Fire Code with reference to distances between tanks of two separate companies, which exception may be approved upon waiver of consent, hereinafter made a condition of this permit, and the Council finds that said revocable permit should be granted under certain conditions; now, therefore, a revocable permit hereby is granted to Union Oil Company of California by J.R. Hannaman, Project Manager, to construct an additional flammable liquids storage tank on their property at 5528 N.W. Doane Avenue and to enlarge the capacity of one and change its location, at its tank yard 5528 N.W. Doane Avenue, in the City of Portland, all in accordance with the following terms and conditions:

a. That the Company's drawing No. 6701-Y-5-2, dated June 22, 1967, revised November 21, 1967, and the Company's permit application letter dated November 27, 1967, shall become part of this ordinance permit.

b. That no flammable liquid with boil-over characteristics shall be stored in any tank authorized in this ordinance.

c. That no flammable liquid having a flash point below 73°F. and having a boiling point below 100°F. shall be stored in any tank built to API Standard No. 650 specifications.

d. That the tanks shall be built in accordance with the American Petroleum Institute Standard No. 650, entitled "Welded Steel Tanks for Oil Storage, Second Ed. April 1964", and shall bear the API Monogram.

ORDINANCE No.

e. That all pipes, valves and fittings shall be equal to the requirements of Chapter III of the Flammable and Combustible Liquids Code, of Volume 1 of the National Fire Codes, "Flammable Liquids," 1966-67 Ed (NFPA Pamphlet No. 30).


f. That all construction, including tanks, tank pads, pipe supports, pumps and walkways shall be accomplished under permit from the Bureau of Buildings of the City and be in accordance with detailed drawings submitted to and approved by said Bureau.

g. That Union Oil Company of California obtain a letter of authorization from the Standard Oil Company of California in which the Standard Oil Company shall waive the requirement that Union Oil tanks No. 4258 and No. 4266 shall be not less than 15 feet from the Standard Oil Company's tank farm boundary line, and that in lieu of this spacing requirement the Fire Marshal may substitute the distance requirements provided in Section 14-1411 for the minimum distances between aboveground flammable liquids tanks.


Section 2. Nothing contained herein shall be taken or deemed to exempt the Union Oil Company of California from compliance with any other applicable provisions of the Fire Code or other ordinances of the City of Portland, and no expenditure of money, lapse of time, or any act or thing shall prevent the Council from at any time revoking this permit and requiring full compliance with the applicable provisions of laws, codes and ordinances of the City of Portland. No action shall be taken hereunder until a suitable document, approved as to form by the City Attorney, shall have been signed and filed with the City Auditor by said company, accepting and agreeing to the terms, provisions and conditions hereof.

Section 3. Inasmuch as this ordinance is necessary for the immediate preservation of the public health, peace and safety of the City of Portland in this: In order that there may be no unnecessary delay in construction as set forth in Section 1 hereof, which construction is urgently needed; therefore an emergency hereby is declared to exist and this ordinance shall be in force and effect from and after its passage by the Council.

Passed by the Council, DEC 21 1967
Commissioner Earl
12-8-67
DAW:gm


PRESIDENT OF THE COUNCIL AND ACTING
Mayor of the City of Portland

Attest:


Auditor of the City of Portland

Calendar No. 5365

INTRODUCED BY
Commissioner Earl

ORDINANCE No. 125936

Title

An Ordinance granting a revocable permit to Union Oil Company of California to construct a flammable liquids storage tank at their property at 5528 N.W. Doane Avenue, subject to certain conditions and declaring an emergency.

THURSDAY

THE COMMISSIONERS VOTED AS FOLLOWS:

	Yes	Na/s
Bowes	1	
Earl	1	
Grayson	1	
Ivancie	1	
Schrunk	1	

FOUR-FIFTHS CALENDAR

Bowes	
Earl	
Grayson	
Ivancie	
Schrunk	

Filed DEC 14 1967

RAY SMITH

Auditor of the CITY OF PORTLAND

By, *Robert A. Smith* Deputy

DRAWN BY

DATE: gmn
12-8-67

NOTED BY THE COMMISSIONER

Affairs

Finance and
Administration

Safety

Utilities

Works

City Attorney

NOTED FOR CITY AUDITOR

EARL

APPROVED

Date

By

City Engineer

Date

By